

**IS : 1343 - 1980**  
**(Reaffirmed 1999)**  
**Edition 2.1**  
**(1984-10)**

*Indian Standard*  
**CODE OF PRACTICE FOR  
PRESTRESSED CONCRETE**  
*( First Revision )*

(Incorporating Amendment No. 1)

UDC 624.012.46 : 006.76

© BIS 2003

**BUREAU OF INDIAN STANDARDS**  
MANAK BHAVAN, 9 BHADUR SHAH ZAFAR MARG  
NEW DELHI 110002

**Price Group 11**

*Indian Standard*  
**CODE OF PRACTICE FOR  
 PRESTRESSED CONCRETE**  
*( First Revision )*

---

Cement and Concrete Sectional Committee, BDC 2

*Chairman*

DR H. C. VISVESVARAYA

*Representing*

Cement Research Institute of India, New Delhi

*Members*

ADDITIONAL DIRECTOR, STANDARDS Research, Designs & Standards Organization  
 (B & S) (Ministry of Railways), Lucknow

DEPUTY DIRECTOR, STANDARDS  
 (B & S) (*Alternate*)

SHRI K. P. BANERJEE Larsen & Toubro Ltd, Bombay

SHRI HARISH N. MALANI (*Alternate*)

SHRI S. K. BANERJEE National Test House, Calcutta

SHRI R. N. BANSAL Beas Designs Organization, Nangal Township

SHRI T. C. GARG (*Alternate*)

CHIEF ENGINEER (DESIGNS) Central Public Works Department, New Delhi

EXECUTIVE ENGINEER (DESIGNS) III

(*Alternate*)

CHIEF ENGINEER (PROJECTS) Irrigation Department, Government of Punjab,  
 Chandigarh

DIRECTOR, IPRI (*Alternate*)

DIRECTOR (CSMRS) Central Water Commission, New Delhi

DEPUTY DIRECTOR (CSMRS) (*Alternate*)

DR R. K. GHOSH Central Road Research Institute (CSIR), New Delhi

SHRI Y. R. PHULL (*Alternate I*)

SHRI M. DINAKARAN (*Alternate II*)

DR R. K. GHOSH Indian Roads Congress, New Delhi

SHRI B. R. GOVIND Engineer-in-Chief's Branch, Army Headquarters,  
 New Delhi

SHRI P. C. JAIN (*Alternate*)

SHRI A. K. GUPTA Hyderabad Asbestos Cement Products Ltd,  
 Hyderabad

DR R. R. HATTIANGADI The Associated Cement Companies Ltd, Bombay

SHRI P. J. JAGUS (*Alternate*)

DR IQBAL ALI Engineering Research Laboratories, Hyderabad

SHRI S. R. KULKARNI M. N. Dastur & Co Pvt Ltd, Calcutta

(*Continued on page 2*)

© BIS 2003

**BUREAU OF INDIAN STANDARDS**

This publication is protected under the *Indian Copyright Act* (XIV of 1957) and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

## IS : 1343 - 1980

( Continued from page 1 )

<i>Members</i>	<i>Representing</i>
SHRI S. K. LAHA	The Institution of Engineers (India), Calcutta
SHRI B. T. UNWALLA ( <i>Alternate</i> )	
DR MOHAN RAI	Central Building Research Institute (CSIR), Roorkee
DR S. S. REHSI ( <i>Alternate</i> )	
SHRI K. K. NAMBIAR	In personal capacity ( 'Ramanalaya' 11 First Crescent Park Road, Gandhi Nagar, Adyar, Madras )
SHRI H. S. PASRICHA	Hindustan Prefab Ltd, New Delhi
SHRI C. S. MISHRA ( <i>Alternate</i> )	
DR M. RAMAIAH	Structural Engineering Research Centre (CSIR), Roorkee
DR N. S. BHAL ( <i>Alternate</i> )	
SHRI G. RAMDAS	Directorate General of Supplies and Disposals, New Delhi
DR A. V. R. RAO	National Buildings Organization, New Delhi
SHRI J. SEN GUPTA ( <i>Alternate</i> )	
SHRI R. V. CHALAPATHI RAO	Geological Survey of India, Calcutta
SHRI S. ROY ( <i>Alternate</i> )	
SHRI T. N. S. RAO	Gammon India Ltd, Bombay
SHRI S. R. PINHEIRO ( <i>Alternate</i> )	
SHRI ARJUN RIJHSINGHANI	Cement Corporation of India Ltd, New Delhi
SHRI K. VITHAL RAO ( <i>Alternate</i> )	
SECRETARY	Central Board of Irrigation and Power, New Delhi
DEPUTY SECRETARY (I) ( <i>Alternate</i> )	
SHRI N. SIVAGURU	Roads Wing, Ministry of Shipping and Transport, New Delhi
SHRI R. L. KAPOOR ( <i>Alternate</i> )	
SHRI K. A. SUBRAMANIAM	The India Cements Ltd, Madras
SHRI P. S. RAMACHANDRAN ( <i>Alternate</i> )	
SUPERINTENDING ENGINEER (DESIGNS)	Public Works Department, Government of Tamil Nadu, Madras
EXECUTIVE ENGINEER (SM & R DIVISION) ( <i>Alternate</i> )	
SHRI L. SWAROOP	Dalmia Cement (Bharat) Ltd, New Delhi
SHRI A. V. RAMANA ( <i>Alternate</i> )	
SHRI B. T. UNWALLA	The Concrete Association of India, Bombay
SHRI Y. K. MEHTA ( <i>Alternate</i> )	
SHRI D. AJITHA SIMHA, Deputy Director General [Former Director (Civ Engg)]	} Director General, ISI ( <i>Ex-officio Member</i> )
SHRI G. RAMAN, Director (Civ Engg)	
	<i>Former Secretary</i>
	SHRI D. AJITHA SIMHA Deputy Director General [Former Director (Civ Engg)], ISI <i>Secretary</i>
	SHRI M. N. NEELAKANDHAN Assistant Director (Civ Engg), ISI

( Continued on page 61 )

**CONTENTS**

	PAGE
0. FOREWORD	6
<b>SECTION 1 GENERAL</b>	
1. SCOPE	8
2. TERMINOLOGY	9
3. SYMBOLS	10
<b>SECTION 2 MATERIALS, WORKMANSHIP, INSPECTION AND TESTING</b>	
4. MATERIALS	12
4.1 CEMENT	12
4.2 AGGREGATES	12
4.3 WATER	13
4.4 ADMIXTURES	13
4.5 PRESTRESSING STEEL	13
4.6 UNTENSIONED STEEL	14
4.7 STORAGE OF MATERIALS	14
5. CONCRETE	15
5.1 GRADES	15
5.2 PROPERTIES OF CONCRETE	15
6. WORKABILITY OF CONCRETE	17
7. DURABILITY	17
8. CONCRETE MIX PROPORTIONING	18
8.1 MIX PROPORTION	18
8.2 DESIGN MIX CONCRETE	19
9. PRODUCTION AND CONTROL OF CONCRETE	19
9.1 QUALITY OF MATERIALS	19
10. FORMWORK	19
11. ASSEMBLY OF PRESTRESSING AND REINFORCING STEEL	19
11.1 PRESTRESSING STEEL	19

	PAGE
11.2 SHEATHS AND EXTRACTABLE CORES	22
11.3 REINFORCING STEEL	23
12. PRESTRESSING	23
12.1 PRESTRESSING EQUIPMENT	23
12.2 PROCEDURE FOR TENSIONING AND TRANSFER	25
12.3 GROUTING	26
13. TRANSPORTING, PLACING, COMPACTING AND CURING	28
14. CONCRETING UNDER SPECIAL CONDITIONS	29
14.1 WORK IN EXTREME WEATHER CONDITIONS	29
15. SAMPLING AND STRENGTH TEST OF CONCRETE	29
16. ACCEPTANCE CRITERIA	30
17. INSPECTION AND TESTING OF STRUCTURES	30
<b>SECTION 3 GENERAL DESIGN REQUIREMENTS</b>	
18. GENERAL DESIGN REQUIREMENTS	30
<b>SECTION 4 STRUCTURAL DESIGN: LIMIT STATE METHOD</b>	
19. SAFETY AND SERVICEABILITY REQUIREMENTS	38
19.1 LIMIT STATE DESIGN	38
19.2 LIMIT STATE OF COLLAPSE	38
19.3 LIMIT STATES OF SERVICEABILITY	39
20. CHARACTERISTIC AND DESIGN VALUES AND PARTIAL SAFETY FACTORS	40
20.1 CHARACTERISTIC STRENGTH OF MATERIALS	40
20.2 CHARACTERISTIC LOADS	40
20.3 DESIGN VALUES	40
20.4 PARTIAL SAFETY FACTORS	41
21. ANALYSIS	41
21.1 ANALYSIS OF STRUCTURE	41

	PAGE
22. LIMIT STATE OF COLLAPSE	43
22.1 LIMIT STATE OF COLLAPSE: FLEXURE	43
22.2 LIMIT STATE OF COLLAPSE: COMPRESSION	46
22.3 LIMIT STATE OF COLLAPSE: TENSION	46
22.4 LIMIT STATE OF COLLAPSE: SHEAR	46
22.5 LIMIT STATE OF COLLAPSE: TORSION	49
22.6 LIMIT STATE OF SERVICEABILITY: DEFLECTION	52
22.7 LIMIT STATE OF SERVICEABILITY: CRACKING	53
22.8 LIMIT STATE OF SERVICEABILITY: MAXIMUM COMPRESSION	54
APPENDIX A REQUIREMENTS FOR DURABILITY	57
APPENDIX B MOMENTS OF RESISTANCE FOR RECTANGULAR AND T-SECTIONS	59

*Indian Standard*  
**CODE OF PRACTICE FOR  
PRESTRESSED CONCRETE**  
*( First revision )*

**0. FOREWORD**

**0.1** This Indian Standard (First Revision) was adopted by the Indian Standards Institution on 30 December 1980, after the draft finalized by the Cement and Concrete Sectional Committee had been approved by the Civil Engineering Division Council.

**0.2** This standard was first published in 1960. This revision was taken up with a view to keeping abreast with the rapid development in the field of concrete technology and also to bring in further clarifications and modifications in the light of experience gained while applying the provisions of the earlier version of the code to practical situations.

**0.3** The format and arrangement of clauses in the code have been changed from the earlier version. The matter has now been divided into four sections as follows:

Section 1 General

Section 2 Materials, Workmanship, Inspection and Testing

Section 3 General Design Requirements

Section 4 Structural Design: Limit State Method

**0.3.1** In this revision, an attempt has been made to unify the codal provisions between prestressed concrete structures and reinforced concrete structures, as is necessary. As a result, many of the provisions in Section 2 Materials, Workmanship, Inspection and Testing and Section 3 General Design Requirements of IS : 456-1978\* apply to prestressed concrete structures and, therefore, only reference has been made to such provisions in this code.

**0.3.2** In some clauses, the code recommends reference to specialist literature, since the current knowledge on some aspects of design has not yet crystallized. This has also been done in order to avoid burdening the code with a lot of details which may not be required for the design of great majority of structures.

---

\*Code of practice for plain and reinforced concrete (*third revision*).

**0.3.3** SI Units have been used in this code, the values of stresses being in units of  $\text{N/mm}^2$ . While converting the values from the earlier units of  $\text{kg/cm}^2$ , the values have been rationalized rather than giving the exact conversion.

**0.3.4** While deciding on the symbols used in this code, the recommendations of ISO 3898-1976\* have been taken into consideration. However, considering the convenience of the users of the code, the familiar symbols of the old version have been retained to the extent possible.

**0.4** This revision incorporates a number of important changes. The major changes in this revision are on the following lines:

- a) The concept of limit state which provides a rational approach, taking into account variations in material strengths and loads on semi-probabilistic basis, has been introduced. This, in fact, is a rationalization of the ultimate load method, covered in the earlier version.
- b) Provision for intermediate degrees of prestress (partial prestress) has been included. Consequently, the code covers 3 types of structures, the types being associated with the permissible tensile stress in concrete.
- c) The method of design for shear and torsion has been completely revised, incorporating the results of the latest research on the subject.
- d) Recommendations regarding transmission length of prestressing tendons have been elaborated.
- e) Recommendations for ensuring lateral stability during handling and erection have been modified.
- f) Considerations regarding durability have been detailed with guidance concerning minimum cement content and maximum water-cement ratio for different environmental conditions, including types of cement to be used for resisting sulphate attack. Limitations on total chloride and sulphate content of concrete have also been given.

**0.4.1** In IS : 456-1978†, major changes have been incorporated in provisions relating to materials, workmanship, inspection and testing, and general design requirements. In view of the attempt at unification between the provisions of reinforced concrete and prestressed concrete codes, these changes are relevant to prestressed concrete code also wherever reference has been made to related provisions of IS : 456-1978†.

---

\*Bases for design of structures — Notations — General symbols.

†Code of practice for plain and reinforced concrete (*third revision*).



## IS : 1343 - 1980

**0.5** In this code, it has been assumed that the design of prestressed concrete structures is entrusted to a qualified engineer, and that the execution of the work is carried out under the direction of an experienced supervisor.

**0.6** The Sectional Committee, responsible for the preparation of this standard, has taken into consideration the views of manufacturers, users, engineers, architects, builders and technologists and has related the standard to the manufacturing and trade practices followed in this country in this field. Due weightage has also been given to the need for international co-ordination among standards prevailing in different countries of the world. These considerations led the Sectional Committee to derive assistance from the following:

ACI 318-77 ACI Standard building code requirements for reinforced concrete. American Concrete Institute.

CP 110 : Part I : 1972 Code of practice for the structural use of concrete: Part I Design, materials and workmanship. British Standards Institution.

AS 1481-1974 SAA Prestressed concrete code. Standards Association of Australia.

Assistance has also been derived from the published documents of the following organizations:

Comite Euro — International Du Beton  
International Standards Organization

**0.7** This edition 2.1 incorporates Amendment No. 1 (October 1984). Side bar indicates modification of the text as the result of incorporation of the amendment.

**0.8** For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS : 2-1960\*. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

## SECTION 1 GENERAL

### 1. SCOPE

**1.1** This code deals with the general structural use of prestressed concrete. It covers both work carried out on site and the manufacture of precast prestressed concrete units.

**1.2** Special requirements of structures such as pipes and poles covered in respective codes have not been covered in this code; these codes shall be used in conjunction with this code.

---

\*Rules for rounding off numerical values (*revised*).

## 2. TERMINOLOGY

**2.0** For the purpose of this code, the definitions given in IS : 4845-1968\* and IS : 6461 (Parts I to XII)† shall generally apply; however, some of the important definitions are given below:

**2.1 Anchorage** — In post-tensioning, a device used to anchor the tendon to the concrete member; in pre-tensioning, a device used to anchor the tendon during hardening of the concrete.

**2.2 Bonded Member** — A prestressed concrete in which tendons are bonded to the concrete either directly or through grouting.

**2.3 Bonded Post-tensioning** — Post-tensioned construction in which the annular spaces around the tendons are grouted after stressing, thereby bonding the tendon to the concrete section.

**2.4 Characteristic Load** — Load which has 95 percent probability of not being exceeded during the life of the structure ( *see 20.2* ).

**2.5 Characteristic Strength** — Strength of material below which not more than 5 percent of the test results are expected to fall ( *see 20.1* ).

**2.6 Column or Strut** — A compression member of rectangular section, the effective length of which exceeds three times the least lateral dimension.

**2.7 Creep in Concrete** — Increase with time in the strain of concrete subjected to sustained stress.

**2.8 Creep Coefficient** — The ratio of creep strain to elastic strain in concrete.

**2.9 Final Prestress** — The stress which exists after substantially all losses have occurred.

---

\*Definitions and terminology relating to hydraulic cement.

†Glossary of terms relating to cement concrete:

(Part I)-1972 Concrete aggregates

(Part II)-1972 Materials (other than cement and aggregate)

(Part III)-1972 Reinforcement

(Part IV)-1972 Types of concrete

(Part V)-1972 Formwork for concrete

(Part VI)-1972 Equipment, tools and plant

(Part VII)-1973 Mixing, laying, compaction, curing and other construction aspects

(Part VIII)-1973 Properties of concrete

(Part IX)-1973 Structural aspects

(Part X)-1973 Tests and testing apparatus

(Part XI)-1973 Prestressed concrete

(Part XII)-1973 Miscellaneous

## IS : 1343 - 1980

**2.10 Final Tension** — The tension in the steel corresponding to the state of the final prestress.

**2.11 Initial Prestress** — The prestress in the concrete at transfer.

**2.12 Initial Tension** — The maximum stress induced in the prestressing tendon at the time of the stressing operation.

**2.13 Post-tensioning** — A method of prestressing concrete in which prestressing steel is tensioned against the hardened concrete.

**2.14 Prestressed Concrete** — Concrete in which permanent internal stresses are deliberately introduced, usually by tensioned steel, to counteract to the desired degree the stresses caused in the member in service.

**2.15 Pre-tensioning** — A method of prestressing concrete in which the tendons are tensioned before concreting.

**2.16 Short Column** — A column of rectangular section, the effective length of which does not exceed 12 times the least lateral dimension.

**2.17 Slender Column** — A column of rectangular section, the effective length of which exceeds 12 times the least lateral dimension.

**2.18 Shrinkage Loss** — The loss of stress in the prestressing steel resulting from the shrinkage of the concrete.

**2.19 Stress at Transfer** — The stress in both the prestressing tendon and the concrete at the stage when the prestressing tendon is released from the prestressing mechanism.

**2.20 Tendon** — A steel element, such as a wire, cable, bar, rod or strand used to impart prestress to concrete when the element is tensioned.

**2.21 Transfer** — The act of transferring the stress in prestressing tendons from the jacks or pre-tensioning bed to the concrete member.

**2.22 Transmission Length** — The distance required at the end of a pretensioned tendon for developing the maximum tendon stress by bond.

## 3. SYMBOLS

**3.1** For the purpose of this code, the following letter symbols shall have the meaning indicated against each; where other symbols are used, they are explained at the appropriate place:

<i>A</i>	Area
<i>B</i>	Breadth of beam
<i>b<sub>w</sub></i>	Breadth of web or rib
<i>D</i>	Overall depth of beam

$DL$	Dead load
$d$	Effective depth of beam
$d_t$	Effective depth of beam in shear
$E_c$	Modulus of elasticity of concrete
$EL$	Earthquake load
$E_s$	Modulus of elasticity of steel
$e$	Eccentricity
$F$	Characteristic load
$F_{bst}$	Bursting tensile force
$F_d$	Design load
$f$	Characteristic strength of material
$f_{ci}$	Cube strength of concrete at transfer
$f_{ck}$	Characteristic compressive strength of concrete
$f_{cp}$	Compressive stress at centroidal axis due to prestress or average intensity of effective prestress in concrete
$f_{cr}$	Modulus of rupture of concrete (flexural tensile strength)
$f_d$	Design strength
$f_p$	Characteristic strength of prestressing steel
$f_{pe}$	Maximum prestress after losses
$f_{pi}$	Maximum initial prestress
$f_{hu}$	Ultimate tensile stress in the tendons
$f_t$	Maximum principal tensile stress
$f_v$	Characteristic strength of reinforcement
$LL$	Live load or imposed load
$M$	Bending moment
$m$	Modular ratio
$s$	Spacing of stirrups
$T$	Torsional moment
$V$	Shear force
$V_c$	Ultimate shear resistance of concrete
$V_{co}$	Ultimate shear resistance of a section uncracked in flexure
$V_{cr}$	Ultimate shear resistance of a section cracked in flexure
$WL$	Wind load
$x_u$	Depth of neutral axis
$\sqrt{f}$	Partial safety factor for load
$\sqrt{m}$	Partial safety factor for material

## IS : 1343 - 1980

$\delta_m$	Percentage reduction in moment
$\tau_c$	Shear stress in concrete
$\phi$	Diameter of tendon or bar

### SECTION 2 MATERIALS, WORKMANSHIP, INSPECTION AND TESTING

#### 4. MATERIALS

**4.1 Cement** — The cement used shall be any of the following, with the prior approval of the engineer-in-charge:

- a) Ordinary Portland cement conforming to IS : 269-1976\*;
- b) Portland slag cement conforming to IS : 455-1976†, but with not more than 50 percent slag content;
- c) Rapid-hardening Portland cement conforming to IS : 8041-1978‡; and
- d) High strength ordinary Portland cement conforming to IS : 8112-1976§.

**4.2 Aggregates** — All aggregates shall comply with the requirements of IS : 383-1970 || .

**4.2.1** The nominal maximum size of coarse aggregate shall be as large as possible subject to the following:

- a) In no case greater than one-fourth the minimum thickness of the member, provided that the concrete can be placed without difficulty so as to surround all prestressing tendons and reinforcements and fill the corners of the form.
- b) It shall be 5 mm less than the spacing between the cables, strands or sheathings where provided.
- c) Not more than 40 mm; aggregates having a maximum nominal size of 20 mm or smaller are generally considered satisfactory.

**4.2.2** Coarse and fine aggregates shall be batched separately.

---

\*Specification for ordinary and low heat Portland cement (*third revision*).

†Specification for Portland slag cement (*third revision*).

‡Specification for rapid hardening Portland cement (*first revision*).

§Specification for high strength ordinary Portland cement.

||Specification for coarse and fine aggregates from natural sources for concrete (*second revision*).

**4.3 Water** — The requirements of water used for mixing and curing shall conform to the requirements given in IS : 456-1978\*. However, use of sea water is prohibited.

**4.4 Admixtures** — Admixtures may be used with the approval of the engineer-in-charge. However use of any admixture containing chlorides in any form is prohibited.

**4.4.1** The admixtures shall conform to IS : 9103-1979†.

## 4.5 Prestressing Steel

**4.5.1** The prestressing steel shall be any one of the following:

- a) Plain hard-drawn steel wire conforming to IS : 1785 (Part I)-1966‡ and IS : 1785 (Part II)-1967§,
- b) Cold-drawn indented wire conforming to IS : 6003-1970 ||,
- c) High tensile steel bar conforming to IS : 2090-1962¶], and
- d) Uncoated stress relieved strand conforming to IS : 6006-1970\*\*.

**4.5.1.1** All prestressing steel shall be free from splits, harmful scratches, surface flaws; rough, jagged and imperfect edges and other defects likely to impair its use in prestressed concrete. Slight rust may be permitted provided there is no surface pitting visible to the naked eye.

**4.5.2** Coupling units and other similar fixtures used in conjunction with the wires or bars shall have an ultimate tensile strength of not less than the individual strengths of the wires or bars being joined.

**4.5.3 Modulus of Elasticity** — The value of the modulus of elasticity of steel used for the design of prestressed concrete members shall preferably be determined by tests on samples of steel to be used for the construction. For the purposes of this clause, a value given by the manufacturer of the prestressing steel shall be considered as fulfilling the necessary requirements.

---

\*Code of practice for plain and reinforced concrete ( *third revision* ).

†Specification for admixtures for concrete.

‡Specification for plain hard-drawn steel wire for prestressed concrete: Part I Cold-drawn stress-relieved wire ( *revised* ).

§Specification for plain hard-drawn steel wire for prestressed concrete: Part II As-drawn wire.

|| Specification for indented wire for prestressed concrete.

¶] Specification for high tensile steel bars used in prestressed concrete.

\*\*Specification for uncoated stress relieved strand for prestressed concrete.

## IS : 1343 - 1980

**4.5.3.1** Where it is not possible to ascertain the modulus of elasticity by test or from the manufacturer of the steel, the following values may be adopted:

<i>Type of Steel</i>	<i>Modulus of Elasticity, E, kN/mm<sup>2</sup></i>
Plain cold-drawn wires [conforming to IS : 1785 (Part I)-1966*, IS : 1785 (Part II)-1967† and IS : 6003-1970‡]	210
High tensile steel bars rolled or heat-treated (conforming to IS : 2090-1962§)	200
Strands (conforming to IS : 6006-1970   )	195

**4.6 Untensioned Steel** — Reinforcement used as untensioned steel shall be any of the following:

- a) Mild steel and medium tensile steel bars conforming to IS : 432 (Part I)-1966¶,
- b) Hot-rolled deformed bars conforming to IS : 1139-1966\*\*,
- c) Cold-twisted bars conforming to IS : 1786-1979††, and
- d) Hard-drawn steel wire fabric conforming to IS : 1566-1967‡‡.

**4.7 Storage of Materials** — Storage of materials shall be as per IS : 4082-1978§§.

---

\*Specification for plain hard-drawn steel wire for prestressed concrete: Part I Cold drawn stress-relieved wire (*revised*).

†Specification for plain hard drawn steel wire for prestressed concrete: Part II As-drawn wire.

‡Specification for indented wire for prestressed concrete.

§Specification for high tensile steel bars used in prestressed concrete.

|| Specification for uncoated stress relieved strand for prestressed concrete.

¶Specification for mild steel and medium tensile steel bars and hard drawn steel wire for concrete reinforcement: Part I Mild steel and medium tensile steel bars (*second revision*).

\*\*Specification for hot rolled mild steel, medium tensile steel and high yield strength steel deformed bars for concrete reinforcement (*revised*).

††Specification for cold-worked steel high strength deformed bars for concrete reinforcement (*second revision*).

‡‡Specification for hard-drawn steel wire fabric for concrete reinforcement (*first revision*).

§§Recommendations on stacking and storage of construction materials at site.

## 5. CONCRETE

**5.1 Grades** — The concrete shall be in grades designated as per Table 1.

**5.1.1** The characteristic strength of concrete is defined as the strength of the concrete below which not more than 5 percent of the test results are expected to fall.

**TABLE 1 GRADES OF CONCRETE**  
( Clauses 5.1, 5.2.1, 8.2.1 and 20.1 )

GRADE DESIGNATION	SPECIFIED CHARACTERISTIC COMPRESSIVE STRENGTH AT 28 DAYS N/mm <sup>2</sup>
(1)	(2)
M 30	30
M 35	35
M 40	40
M 45	45
M 50	50
M 55	55
M 60	60

NOTE 1 — In the designation of a concrete mix, letter M refers to the mix and the number to the specified characteristic compressive strength of 15-cm cube at 28 days, expressed in N/mm<sup>2</sup>.

NOTE 2 — For pre-tensioned prestressed concrete, the grade of concrete shall be not less than M 40.

## 5.2 Properties of Concrete

**5.2.1 Increase in Strength with Age** — Where it can be shown that a member will not receive its full design stress within a period of 28 days after the casting of the member (for example, in foundations and lower columns in multi-storey buildings); the characteristic compressive strength given in Table 1 may be increased by multiplying by the factors given below:

<i>Minimum Age of Member When Full Design Stress is Expected</i> (Months)	<i>Age Factor</i>
1	1.0
3	1.10
6	1.15
12	1.20

NOTE 1 — Where members are subjected to lower direct load during construction, they should be checked for stresses resulting from combination of direct load and bending during construction.

NOTE 2 — The design strength shall be based on the increased value of compressive strength.



**IS : 1343 - 1980**

**5.2.2 Tensile Strength of Concrete** — The flexural strength shall be obtained as per IS : 516-1959\*. When the designer wishes to use an estimate of the flexural strength from the compressive strength, the following formula may be used:

$$f_{cr} = 0.7 \sqrt{f_{ck}} \text{ N/mm}^2$$

where

$f_{cr}$  = flexural strength in  $\text{N/mm}^2$ , and

$f_{ck}$  = characteristic compressive strength of concrete in  $\text{N/mm}^2$ .

**5.2.3 Elastic Deformation** — The modulus of elasticity is primarily influenced by the elastic properties of the aggregate and to a lesser extent by the conditions of curing and age of the concrete, the mix proportions and the type of cement. The modulus of elasticity is normally related to the compressive strength of concrete.

**5.2.3.1** In the absence of test data, the modulus of elasticity for structural concrete may be assumed as follows:

$$E_c = 5\,700 \sqrt{f_{ck}}$$

where

$E_c$  = short-term static modulus of elasticity in  $\text{N/mm}^2$ , and

$f_{ck}$  = characteristic compressive strength of concrete in  $\text{N/mm}^2$ .

**5.2.4 Shrinkage** — The shrinkage of concrete depends upon the constituents of concrete, size of the member and environmental conditions. For a given environment, the shrinkage of concrete is most influenced by the total amount of water present in the concrete at the time of mixing and, to a lesser extent, by the cement content.

**5.2.4.1** In the absence of test data, the approximate value of shrinkage strain for design shall be assumed as follows:

For pre-tensioning = 0.000 3

For post-tensioning =  $\frac{0.000\ 2}{\text{Log}_{10}(t + 2)}$

where

t = age of concrete at transfer in days.

NOTE — The value of shrinkage strain for design of post-tensioned concrete may be increased by 50 percent in dry atmospheric conditions, subject to a maximum value of 0.000 3.

**5.2.4.2** For the calculation of deformation of concrete at some stage before the maximum shrinkage is reached, it may be assumed that

---

\*Methods of test for strength of concrete.

half of the shrinkage takes place during the first month and that about three-quarters of the shrinkage takes place in first six months after commencement of drying.

**5.2.5 Creep of Concrete** — Creep of concrete depends, in addition to the factors listed in **5.2.4** on the stress in the concrete, age at loading and the duration of loading. As long as the stress in concrete does not exceed one-third of characteristic compressive strength, creep may be assumed to be proportional to the stress.

**5.2.5.1** In the absence of experimental data and detailed information on the effect of the variables, the ultimate creep strain may be estimated from the following values of creep coefficient (that is, ultimate creep strain/elastic strain at the age of loading):

<i>Age at Loading</i>	<i>Creep Coefficient</i>
7 days	2.2
28 days	1.6
1 year	1.1

NOTE — The ultimate creep strain estimated as per **5.2.5.1** does not include the elastic strain.

**5.2.5.2** For the calculation of deformation at some stage before the total creep is reached, it may be assumed that about half the total creep takes place in the first month after loading and that about three-quarters of the total creep takes place in the first six months after loading.

**5.2.6 Thermal Expansion** — The coefficient of thermal expansion depends on nature of cement, the aggregate, the cement content, the relative humidity and the size of sections. For values of coefficient of thermal expansion for concrete with different aggregates, clause **5.2.6** of IS : 456-1978\* may be referred to.

## **6. WORKABILITY OF CONCRETE**

**6.1** The concrete mix proportions chosen should be such that the concrete is of adequate workability for the placing conditions of the concrete and can properly be compacted with the means available. Suggested ranges of values of workability of concrete are given in IS : 456-1978\*.

## **7. DURABILITY**

**7.1** The durability of concrete depends on its resistance to deterioration and the environment in which it is placed. The resistance

---

\*Code of practice for plain and reinforced concrete (*third revision*).

## IS : 1343 - 1980

of concrete to weathering, chemical attack, abrasion, frost and fire depends largely upon its quality and constituent materials. The strength alone is not a reliable guide to the quality and durability of concrete; it must also have an adequate cement content and a low water-cement ratio.

**7.1.1** One of the main characteristics influencing the durability of concrete is its permeability. With strong, dense aggregates, a suitably low permeability is achieved by having a sufficiently low water-cement ratio, by ensuring as thorough compaction of the concrete as possible and by ensuring sufficient hydration of cement through proper curing methods. Therefore, for given aggregates, the cement content should be sufficient to provide adequate workability with a low water-cement ratio so that concrete can be thoroughly compacted with the means available.

**7.2** Appendix A provides guidance regarding minimum cement content and permissible limits of chloride and sulphate in concrete.

## 8. CONCRETE MIX PROPORTIONING

**8.1 Mix Proportion** — The mix proportions shall be selected to ensure that the workability of the fresh concrete is suitable for the conditions of handling and placing, so that after compaction it surrounds all prestressing tendons and reinforcements if present and completely fills the formwork. When concrete is hardened, it shall have the required strength, durability and surface finish.

**8.1.1** The determination of the proportions of cement, aggregates and water to attain the required strengths shall be made by designing the concrete mix. Such concrete shall be called 'Design mix concrete'.

For prestressed concrete construction, only 'Design mix concrete' shall be used. The cement content in the mix should preferably not exceed  $530 \text{ kg/m}^3$ .

**8.1.2 Information Required** — In specifying a particular grade of concrete, the information to be included shall be:

- a) Grade designation,
- b) Type of cement,
- c) Maximum nominal size of aggregates,
- d) Minimum cement content,
- e) Maximum water-cement ratio, and
- f) Workability.

8.1.2.1 In appropriate circumstances, the following additional information may be specified:

- a) Type of aggregate,
- b) Maximum cement content, and
- c) Whether an admixture shall or shall not be used and the type of admixture and the conditions of use.

## 8.2 Design Mix Concrete

8.2.1 The mix shall be designed to produce the grade of concrete having the required workability and a characteristic strength not less than appropriate values given in Table 1. The procedure given in Indian Standard Recommended guidelines for concrete mix design ( *under preparation* ) may be followed.

## 9. PRODUCTION AND CONTROL OF CONCRETE

9.1 **Quality of Materials** — It is essential for designers and construction engineers to appreciate that the most effective use of prestressed concrete is obtained only when the concrete and the prestressing steel employed are of high quality and strength.

9.2 The provisions of 9 of IS : 456-1978\* shall apply; except that no handmixing shall be permitted in prestressed concrete work.

## 10. FORMWORK

10.1 The provisions of 10 of IS : 456-1978\* shall generally apply. In addition, 10.1.1 shall also apply.

10.1.1 Moulds for pre-tension work shall be sufficiently strong and rigid to withstand, without distortion, the effects of placing and compacting concrete as well as those of prestressing in the case of manufacture by the individual mould process where the prestressing tendon is supported by the mould before transfer.

## 11. ASSEMBLY OF PRESTRESSING AND REINFORCING STEEL

### 11.1 Prestressing Steel

#### 11.1.1 *Straightening*

11.1.1.1 The wire, as supplied, shall preferably be self-straightening when uncoiled. If it is not so, the wire may need to be mechanically straightened before use. In this event, care shall be taken to avoid alteration in the properties of the wire during the straightening process and preferably a test shall be made on a sample of the wire after straightening.

---

\*Code of practice for plain and reinforced concrete ( *third revision* ).

## **IS : 1343 - 1980**

**11.1.1.2** In the case of high tensile alloy steel bars, any straightening (or bending if the design provided for curved bars) shall be carried out by means of a bar-bending machine. Bars shall not be bent when their temperature is less than 10°C.

**11.1.1.3** In no case heat shall be applied to facilitate straightening or bending of prestressing steel.

### **11.1.2 *Arrangement of Wires and Positioning***

**11.1.2.1** All prestressing steel shall be carefully and accurately located in the exact positions shown in the design drawings. The permissible tolerance in the location of the prestressing tendon shall be  $\pm 5$  mm. Curves or bends in prestressing tendon required by the designer shall be gradual and the prestressing tendon shall not be forced around sharp bends or be formed in any manner which is likely to set up undesirable secondary stresses.

**11.1.2.2** The relative position of wires in a cable, whether curved or straight, shall be accurately maintained by suitable means such as sufficiently rigid and adequately distributed spacers.

**11.1.2.3** In the case of post-tension work, the spacing of wires in a cable shall be adequate to ensure the free flow of grout.

**11.1.2.4** The method of fixing and supporting the steel in the mould or the formwork shall be such that it is not displaced during the placing or compaction of the concrete or during tensioning of the steel.

**11.1.2.5** The type of fixtures used for positioning the steel shall be such that it does not give rise to friction greater than that assumed in the design.

### **11.1.3 *Jointing***

**11.1.3.1** High tensile wire other than hard-drawn wire may be joined together by suitable means provided the strength of such joints is not less than the individual strengths of the wires being joined. Hard-drawn wire used in prestressed concrete work shall be continuous over the entire length of the tendon.

**11.1.3.2** High tensile steel bars may be joined together by means of couplings, provided the strength of the coupling is such that in a test to destruction, the bar shall fail before the coupling.

**11.1.3.3** Welding shall not be permitted in either wires or bars.

**11.1.4.1** All cutting to length and trimming of the ends of wires shall be done by suitable mechanical or flame cutters. Where flame cutters

are used, care shall be taken to ensure that the flame does not come into contact with other stressed wires or concrete.

**11.1.4.2** Bars shall preferably be ordered to the exact length required. Any trimming required shall be done only after the bar has been tensioned and the grout has set; it shall then be carried out in accordance with **11.1.4.1**.

**11.1.5** *Protection of Prestressing Steel and Anchorages* — In all constructions of the post-tensioned type, where prestressing is initially carried out without bond, the prestressing tendon shall, at a subsequent date and generally not later than one week after prestressing, be given an adequate protection against corrosion.

**11.1.5.1** *Internal prestressing steel* — Internal prestressing steel is best protected by a cement or cement-sand grout preferably in colloidal form. Care shall be taken to prevent segregation and, for that purpose, only fine sand shall be used.

The grout shall be placed under pressure, and it shall be ensured that the entire space between the duct and the prestressing tendon is properly filled with grout.

Where small ducts are encountered, it is advisable that water is flushed through prior to grouting, care being taken to see that all water is subsequently displaced by grout. In the case of butted assemblies, flushing with water shall be carried out only after the jointing material has properly hardened.

Injection shall proceed from one end or preferably in case of curved ducts from the lowest point of the curve, and shall be continued until the grout overflows from the other end.

**11.1.5.2** *External prestressing steel* — The protection of external prestressing steel is usually best done by encasing the tensioned wires, cables or bars in a dense concrete secured to the main concrete, for example, by wires left projecting from the latter. If a cement-sand mix is used, the cover provided and its density should be adequate to prevent corrosion.

Alternatively, the steel may be encased in bitumen or, where the steel is accessible for inspection and maintenance, paint protection may be provided.

**11.1.5.3** The anchorage shall be adequately protected against damage or corrosion soon after the completion of the final stressing and grouting operations.

#### **11.1.6** *Cover*

**11.1.6.1** In pre-tensioning work, the cover of concrete measured from the outside of the prestressing tendon shall be at least 20 mm.

## IS : 1343 - 1980

**11.1.6.2** In post-tensioned work, where cables and large-sized bars are used, the minimum clear cover from sheathing/duct shall be at least 30 mm or the size of the cable or bar whichever is bigger.

**11.1.6.3** Where prestressed concrete members are located in aggressive environment, the cover specified under **11.1.6.1** and **11.1.6.2** shall be increased by 10 mm.

### 11.1.7 Spacing

**11.1.7.1** In the case of single wires used in pre-tension system, the minimum clear spacing shall not be less than greater of the following :

- a) 3 times diameter of wire, and
- b)  $1\frac{1}{3}$  times the maximum size of aggregate.

**11.1.7.2** In the case of cables or large bars, the minimum clear spacing (measured between sheathings/ducts, wherever used) shall not be less than greater of the following:

- a) 40 mm,
- b) Maximum size of cable or bar, and
- c) 5 mm plus maximum size of aggregate.

### 11.1.8 Grouped Cables

**11.1.8.1** Cables or ducts may be grouped together in groups of not more than four as shown in Fig. 1.

**11.1.8.2** The minimum clear spacing between groups of cables or ducts of grouped cables shall be greater of the following:

- a) 40 mm, and
- b) 5 mm plus maximum size of aggregate.

The vertical distance between groups shall not be less than 50 mm ( see Fig. 1 ).

## 11.2 Sheaths and Extractable Cores

**11.2.1** Sheaths shall be sufficiently water-tight to prevent concrete laitance penetrating in them in quantities likely to increase friction. Special care shall be taken to ensure watertightness at the joints.

**11.2.2** They shall be preferably machine-manufactured and have bores sufficiently large to allow being easily threaded on to the cable or bar in long lengths.

**11.2.3** The tubes or sheaths shall be of such strength as not to be dented or deformed during handling or concreting.

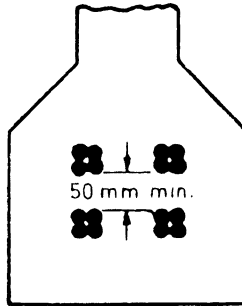


FIG. 1 SPACING OF GROUPS OF CABLES

**11.2.4** The alignment of all sheaths and extractable cores shall be correct to the requirements of the drawings and maintained securely to prevent displacement during placing and compaction of concrete. The permissible tolerance in the location of the sheaths and extractable cores shall be  $\pm 5$  mm. Any distortion of the sheath during concreting may lead to additional friction.

### 11.3 Reinforcing Steel

**11.3.1** Provisions for assembly of reinforcement given in IS : 456-1978\* shall apply.

**11.3.2** The requirements of cover and spacing between bars shall conform to IS : 456-1978\*.

## 12. PRESTRESSING

### 12.1 Prestressing Equipment

#### 12.1.1 *Tensioning Apparatus*

**12.1.1.1** The requirements of **12.1.1** shall apply to both the pre-tensioned and the post-tensioned methods of prestressing concrete except where specifically mentioned otherwise.

**12.1.1.2** Prestressing steel may be tensioned by means of levers, screw jacks, hydraulic jacks or similar mechanical apparatus. The method of tensioning steel covered by this code is generally by means of hydraulic or similar mechanical jacks.

The type of tensioning apparatus shall be such that a controlled force can be applied.

---

\*Code of practice for plain and reinforced concrete (*third revision*).



## IS : 1343 - 1980

The tensioning apparatus shall not induce dangerous secondary stresses or torsional effects on the steel, concrete, or on the anchorage.

**12.1.1.3** The anchorage provided for the temporary gripping of wires or bars on the tensioning apparatus shall be secure and such as not to damage the wire or bar.

**12.1.1.4** Devices attached to the tensioning apparatus for measuring the applied force shall be such that they do not introduce errors exceeding 5 percent.

**12.1.2** *Temporary Gripping Device* — Prestressing tendons may be gripped by wedges, yokes, double cones or any other approved type of gripping devices. The prestressing wires may be gripped singly or in groups. Gripping devices shall be such that in a tensile test, the wire or wires fixed by them would break before failure of the grip itself.

**12.1.3** *Releasing Device* — The releasing device shall be so designed that during the period between the tensioning and release, the tension in the prestressing elements is fully maintained by positive means, such as external anchorages. The device shall enable the transfer of prestress to be carried out gradually so as to avoid large difference of tension between wires in a tendon, severe eccentricities of prestress or the sudden application of stress to the concrete.

### **12.1.4** *Anchorage*

**12.1.4.1** The anchorage may consist of any device, patented or otherwise, which complies with the requirements laid down under **12.1.4.2** to **12.1.4.6**.

**12.1.4.2** The anchoring device shall be capable of holding without more than nominal slip, the prestressing tendon subjected to a load midway between the proposed initial prestressing load and the ultimate strength of the prestressing tendon.

**12.1.4.3** The anchoring device shall be strong enough to resist in all respects a force equal to at least the breaking strength of the prestressing tendon it anchors.

**12.1.4.4** The anchorage shall transfer effectively and distribute, as evenly as possible, the entire force from the prestressing tendon to the concrete without inducing undesirable secondary or local stresses.

**12.1.4.5** The anchorage shall be safe and secure against both dynamic and static loads as well as against impact.

**12.1.4.6** The anchorage shall have provision for the introduction of a suitable protective medium, such as cement grout, for the protection of the prestressing steel unless alternative arrangements are made.

## 12.2 Procedure for Tensioning and Transfer

### 12.2.1 *Stressing*

12.2.1.1 The tensioning of prestressing tendons shall be carried out in a manner that will induce a smooth and even rate of increase of stress in the tendons.

12.2.1.2 The total tension imparted to each tendon shall conform to the requirements of the design. No alteration in the prestressing force in any tendon shall be allowed unless specifically approved by the designer.

12.2.1.3 Any slack in the prestressing tendon shall first be taken up by applying a small initial tension. The initial tension required to remove slackness shall be taken as the starting point for measuring the elongation and a correction shall be applied to the total required elongation to compensate for the initial tensioning of the wire. The extent of correction shall be arrived at by plotting on a graph the gauge reading as abscissae and extensions as ordinates: the intersection of the curve with the Y axis when extended shall be taken to give the effective elongation during initial tensioning, and this effective elongation shall be added to the measured elongation to arrive at the actual total elongation as shown in Fig. 2.

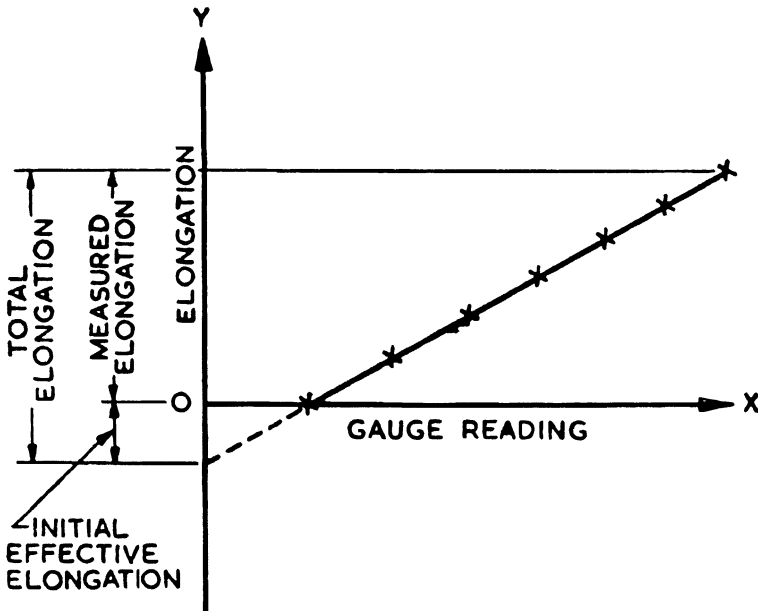


FIG. 2 DETERMINATION OF ACTUAL ELONGATION

## IS : 1343 - 1980

**12.2.1.4** When two or more prestressing tendons are to be tensioned simultaneously, care shall be taken to ensure that all such tendons are of the same length from grip to grip. The provision shall be more carefully observed for tendons of a length smaller than 7.5 m.

**12.2.1.5** The placement of cables or ducts and the order of stressing and grouting shall be so arranged that the prestressing steel, when tensioned and grouted, does not adversely affect the adjoining ducts.

### **12.2.2** *Measurement of Prestressing Force*

**12.2.2.1** The force induced in the prestressing tendon shall be determined by means of gauges attached to the tensioning apparatus as well as by measuring the extension of the steel and relating it to its stress-strain curve. It is essential that both methods are used jointly so that the inaccuracies to which each is singly susceptible are minimized. Due allowance shall be made for the frictional losses in the tensioning apparatus.

**12.2.2.2** The pressure gauges or devices attached to the tensioning apparatus to measure the force shall be periodically calibrated to ensure that they do not at any time introduce errors in reading exceeding 2 percent.

**12.2.2.3** In measuring the extension of prestressing steel, any slip which may occur in the gripping device shall be taken into consideration.

**12.2.3** *Breakage of Wires* — The breakage of wires in any one prestressed concrete member shall not exceed 2.5 percent during tensioning. Wire breakages after anchorage, irrespective of percentage, shall not be condoned without special investigations.

### **12.2.4** *Transfer of Prestressing Force*

**12.2.4.1** The transfer of the prestress shall be carried out gradually so as to avoid large differences of tension between wires in a tendon, severe eccentricities of prestressing force and the sudden application of stress to the concrete.

**12.2.4.2** Where the total prestressing force in a member is built up by successive transfers to the force of a number of individual tendons on to the concrete, account shall be taken of the effect of the successive prestressing.

**12.2.4.3** In the long line and similar methods of prestressing, when the transfer is made on several moulds at a time, care shall be taken to ensure that the prestressing force is evenly applied on all the moulds, and that the transfer of prestress to the concrete is uniform along the entire length of the tension line.

## **12.3** *Grouting*

**12.3.1** The requirements of the grout are fluidity and low sedimentation

(or bleeding) in the plastic state. In the hardened state, it shall be dense, have low shrinkage and be durable. The grouting technique adopted should be such that it can be carried out easily and effectively.

**12.3.2** Grout shall be made from any of the cements specified in 4.1 and water conforming to 4.3. Fine sand passing 150  $\mu\text{m}$  IS Sieve may be added only for ducts of very large size. If permitted by the engineer-in charge, admixtures may be added to improve the performance of the grout. The water-cement ratio for neat cement grouts should be approximately 0.50 by mass, but should in no case exceed 0.55 by mass.

**12.3.2.1** The compressive strength of 100 mm cubes of the grout shall not be less than 17  $\text{N/mm}^2$  at 7 days. Cubes shall be cured in a moist atmosphere for the first 24 hours, and subsequently in water.

### **12.3.3** *Grouting Equipment*

**12.3.3.1** The mixer shall be of a high speed mixing type, capable of mixing with high local turbulence while imparting only a slow motion to the body of the grout. A grout screen should preferably be fitted.

**12.3.3.2** The pump and the injection equipment shall be capable of continuous operation with little, if any, pressure variation and shall have a system for recirculating the grout while actual grouting is not in progress. No compressed air system should be used for grouting work. The pumping equipment shall be able to deliver the grout at a nozzle pressure of at least 0.7  $\text{N/mm}^2$ .

**12.3.3.3** All piping to and from the grout pump shall have a minimum of bends, valves, and changes in diameter and the delivery hose shall be as short as practicable.

**12.3.3.4** All piping, pumping and mixing equipment should be thoroughly washed with clean water after each series of operations or more frequently if necessary. In any case the intervals between the washings shall not exceed 3 hours.

**12.3.4** *Mixing* — Water shall be measured and added to the mixer first, followed by cement. When these are thoroughly mixed, the additive and sand, if any, shall be added. When all the ingredients have been added, mixing shall continue for at least two minutes.

**12.3.5** *Duct Preparation* — Ducts shall be kept clean at all times. Unwanted opening at anchorages and in any other locations shall be sealed before grouting commences.

In all long ducts, or in any duct where considerable changes of level occur and in any large diameter ducts, grout vents shall be provided at all crests and at intervals of 20 m to 30 m so that grout can be injected successively through vents as the grout flows along the ducts. Where water is likely to enter ducts, valley vents shall also be provided for drainage.

**12.3.6 Grout Injection** — Grouts should be injected from the lowest point or ‘uphill’ wherever practicable so that air and water in the duct, being less dense than the grout, will be pushed ahead of the grout mix and be less liable to become entrapped in the grout mix.

Grout mix shall be allowed to flow through vent openings until its consistency is equivalent to that of the grout injected. Vent openings shall then be firmly closed one after the other in the direction of flow. Once good grout mix has commenced to flow freely from the end or ends of the duct, that end or ends shall be closed and the pressure built up inside the duct to  $0.7 \text{ N/mm}^2$  before closing the injection end.

In the case of large ducts where pressure grouting cannot be used, a standpipe or vent pipe shall be provided and kept topped up with cement for an hour or two to replace grout losses due to wastage and subsidence at the termination of grouting operation.

### **13. TRANSPORTING, PLACING, COMPACTING AND CURING**

**13.1** Provisions given in IS : 456-1978\* shall apply. In addition, the provisions given in **13.1.1** and **13.1.2** shall also apply.

**13.1.1** The use of construction joints in prestressed concrete work should preferably be avoided. But, if found necessary, their position and arrangement shall be predetermined by the designer.

#### **13.1.2 Jointing of Butted Assemblies**

**13.1.2.1** The joints of butted assemblies shall be made of either cement, grout or cement mortar or concrete. Grouting shall be used for joints up to 12 mm thick. For joints thicker than 12 mm and preferably for thicknesses between 18 and 25 mm, mortar shall be used. The mortar which may be made of one part cement and one-and-a-half parts sand shall be of a dry consistency and shall be packed hard in layers so that it rings true. Where joints exceeding 75 mm are encountered, the joint shall be made up of concrete.

**13.1.2.2** The stressing operations may be carried out in case of mortar joints immediately after placing the mortar but the stress in the mortar shall not exceed  $7.0 \text{ N/mm}^2$ . In the case of grouted joints and concrete joints the allowable stress in the first 24 hours after placing of the grout or concrete in the joint shall approximate as closely as possible to the strength of the grout or concrete used.

**13.1.2.3** The holes for the prestressing tendons shall be accurately located and shall be in true alignment when the units are put together.

**13.1.2.4** Full tensioning shall not be carried out until the strength of the concrete or mortar in the joint has reached twice the transfer stress.

---

\*Code of practice for plain and reinforced concrete ( *third revision* ).

## 14. CONCRETING UNDER SPECIAL CONDITIONS

**14.1 Work in Extreme Weather Conditions** — During hot or cold weather, the concreting should be done as per the procedure set out in IS : 7861 (Part I)-1975\* or IS : 7861 (Part II)-1981†.

## 15. SAMPLING AND STRENGTH TEST OF CONCRETE

**15.1** The provisions given in IS : 456-1978‡ shall apply; but the optional test requirements of concrete and values of assumed standard deviation shall be as given in Table 2 and Table 3 respectively. In addition, the requirement given in 15.2 shall apply.

**TABLE 2 OPTIONAL TESTS REQUIREMENTS OF CONCRETE**

(1)	GRADE OF CONCRETE	COMPRESSIVE STRENGTH ON 15 cm CUBES, <i>Min</i> AT 7 DAYS	MODULUS OF RUPTURE BY BEAM TEST, <i>MIN</i>	
			AT 72 ± 2 h	AT 7 DAYS
			(3)	(4)
		N/mm <sup>2</sup>	N/mm <sup>2</sup>	
M 30		20.0	2.1	3.0
M 35		23.5	2.3	3.2
M 40		27.0	2.5	3.4
M 45		30.0	2.7	3.6
M 50		33.5	2.9	3.8
M 55		37.0	3.1	4.0
M 60		40.0	3.3	4.2

**TABLE 3 ASSUMED STANDARD DEVIATION**

GRADE OF CONCRETE	ASSUMED STANDARD DEVIATION
(1)	(2)
	N/mm <sup>2</sup>
M 30	6.0
M 35	6.3
M 40	6.6
M 45	7.0
M 50	7.4
M 55	7.7
M 60	7.8

\*Code of practice for extreme weather concreting: Part I Recommended practice for hot weather concreting.

†Code of practice for extreme weather concreting: Part II Recommended practice for cold weather concreting.

‡Code of practice for plain and reinforced concrete (*third revision*).

## IS : 1343 - 1980

**15.2 Concrete Strength at Transfer** — In addition to the tests required as per **15.1**, additional cube tests should be conducted at appropriate intervals to ensure that the concrete strength in the member at transfer conforms to the design requirements. The frequency of sampling and number of cubes should be decided by the engineer-in-charge. The sampling of concrete should preferably be at the point of placing and the cubes should be stored as far as possible under the same conditions as the concrete in the members.

## 16. ACCEPTANCE CRITERIA

**16.1** The provisions of IS : 456-1978\* shall apply.

## 17. INSPECTION AND TESTING OF STRUCTURES

**17.1** The provisions of IS : 456-1978\* shall apply, except for the following:

- a) For type 1 and type 2 structures ( *see 19.3.2* ), if within 24 hours of removal of the imposed load, the structure does not recover at least 85 percent of the deflection under superimposed load, the test may be repeated after a lapse of 72 hours. If the recovery is less than 90 percent, the structure shall be deemed to be unacceptable.
- b) For type 3 structures ( *see 19.3.2* ), if within 24 hours of the imposed load, the structure does not recover at least 75 percent of the deflection under superimposed load, the test may be repeated after a lapse of 72 hours. If the recovery is less than 80 percent, the structure shall be deemed to be unacceptable.

## SECTION 3 GENERAL DESIGN REQUIREMENTS

### 18. GENERAL DESIGN REQUIREMENTS

**18.1** The general design requirements for design of prestressed concrete structures shall be as per clauses 17 to 24 of Section 3 of IS : 456-1978\* except as modified and supplemented in **18.2** to **18.6.5**.

**18.2** The effects of prestress shall also be taken into account in assessing loads and forces.

**18.3** The deductions for prestressing tendons as in **18.3.1** shall be considered for the determination of area, centroid and moment of inertia of the cross-section.

---

\*Code of practice for plain and reinforced concrete ( *third revision* ).

**18.3.1 Deductions for Prestressing Tendons** — In calculating area, centroid and moment of inertia of a cross-section, deduction for prestressing tendons shall be made as follows:

- a) In the case of pre-tensioned members, where the prestressing tendons are single wires distributed on the cross-section or strands of wires of relatively small cross-sectional area, allowance for the prestressing tendons need not be made. Where allowance is made, it shall be on the basis of  $(m-1)$  times the area of the prestressing tendons,  $m$  being the modular ratio.
- b) In the case of post-tensioned members, deductions shall invariably be made for prestressing tendons, cable ducts or sheaths and such other openings whether they are formed longitudinally or transversely. These deductions need not, however, be made for determining the effect of loads applied after the ducts, sheaths or openings have been grouted or filled with concrete. Where such deductions are not made, a transformed area equivalent to  $(m-1)$  times the area of the prestressing tendon shall be taken in calculation,  $m$  being the modular ratio.

NOTE —  $m$  shall be calculated as  $E_s/E_c$ ; for values of  $E_s$  and  $E_c$ , see 4.5.3.1 and 5.2.3.1 respectively. Wherever necessary, creep effects shall also be taken into consideration.

**18.4 Instability During Erection** — In evaluating the slenderness effects during lifting of slender beams, the following factors require consideration:

- a) Beam geometry,
- b) Location of lifting points,
- c) Method of lifting, and
- d) Tolerances in construction.

All beams, which are lifted on vertical or inclined slings, shall be checked for lateral stability and lateral moment on account of tilting of beam due to inaccuracies in location of lifting points, and due to the lateral bow.

For calculating the factor of safety against lateral instability  $\gamma_i$  reference may be made to specialist literature; the factor shall not be less than two.

For determining the lateral moment due to tilting, realistic values which are not likely to be exceeded in practice shall be assumed for the eccentricity of lifting points and the lateral bow. The maximum tensile stress for  $\gamma_i / (\gamma_i - 1)$  times the lateral moment due to tilting shall not exceed  $1.5 \text{ N/mm}^2$ .

## 18.5 Prestressing Requirements

**18.5.1 Maximum Initial Prestress** — At the time of initial tensioning, the maximum tensile stress  $f_{pi}$  immediately behind the anchorages shall not exceed 80 percent of the ultimate tensile strength of the wire or bar or strand.



**18.5.2 Losses in Prestress** — While assessing the stresses in concrete and steel during tensioning operations and later in service, due regard shall be paid to all losses and variations in stress resulting from creep of concrete, shrinkage of concrete, relaxation of steel, the shortening (elastic deformation) of concrete at transfer, and friction and slip of anchorage. Unless otherwise determined by actual tests, allowance for these losses shall be made in accordance with the values specified under **18.5.2.1** to **18.5.2.6**.

In computing the losses in prestress when untensioned reinforcement is present, the effect of the tensile stresses developed by the untensioned reinforcement due to shrinkage and creep shall be considered.

**18.5.2.1 Loss of prestress due to creep of concrete** — The loss of prestress due to creep of concrete under load shall be determined for all the permanently applied loads including the prestress.

The creep loss due to live load stresses, erection stresses and other stresses of short duration may be ignored. The loss of prestress due to creep of concrete is obtained as the product of the modulus of elasticity of the prestressing steel (see **4.5.3**) and the ultimate creep strain of the concrete fibre (see **5.2.5.1**) integrated along the line of centre of gravity of the prestressing steel over its entire length.

The total creep strain during any specific period shall be assumed for all practical purposes, to be the creep strain due to sustained stress equal to the average of the stresses at the beginning and end of the period.

**18.5.2.2 Loss of prestress due to shrinkage of concrete** — The loss of prestress due to shrinkage of concrete shall be the product of the modulus of elasticity of steel (see **4.5.3**) and the shrinkage strain of concrete (see **5.2.4.1**).

**18.5.2.3 Loss of prestress due to relaxation of steel** — The relaxation losses in prestressing steels vary with type of steel, initial prestress, age, and temperature and, therefore, shall be determined from experiments. When experimental values are not available, the relaxation losses may be assumed as given in Table 4.

---

**TABLE 4 RELAXATION LOSSES FOR PRESTRESSING STEEL  
AT 1 000 H AT 27°C**

INITIAL STRESS (1)	RELAXATION LOSS (2) N/mm <sup>2</sup>
0.5 $f_p$	0
0.6 $f_p$	35
0.7 $f_p$	70
0.8 $f_p$	90

NOTE —  $f_p$  is the characteristic strength of prestressing steel.

---

For tendons at higher temperatures or subjected to large lateral loads, greater relaxation losses as specified by the engineer-in-charge shall be allowed for. No reduction in the value of the relaxation losses should be made for a tendon with a load equal to or greater than the relevant jacking force that has been applied for a short time prior to the anchoring of the tendon.

**18.5.2.4 Loss of prestress due to shortening of concrete** — This type of loss occurs when the prestressing tendons upon release from tensioning devices cause the concrete to be compressed. This loss is proportional to the modular ratio and initial prestress in the concrete and shall be calculated as below, assuming that the tendons are located at their centroid:

- a) For pretensioning, the loss of prestress in the tendons at transfer shall be calculated on a modular ratio basis using the stress in the adjacent concrete.
- b) For members with post-tensioned tendons which are not stressed simultaneously, there is a progressive loss of prestress during transfer due to the gradual application of the prestressing forces. This loss of prestress should be calculated on the basis of half the product of the stress in the concrete adjacent to the tendons averaged along their lengths and the modular ratio. Alternatively, the loss of prestress may be exactly computed based on the sequence of tensioning.

**18.5.2.5 Loss of prestress due to slip in anchorage** — Any loss of prestress which may occur due to slip of wires during anchoring or due to the strain of anchorage shall be allowed for in the design. Loss due to slip in anchorage is of special importance with short members and the necessary additional elongation should be provided for at the time of tensioning to compensate for this loss.

**18.5.2.6 Loss of prestress due to friction** — The design shall take into consideration all losses in prestress that may occur during tensioning due to friction between the prestressing tendons and the surrounding concrete or any fixture attached to the steel or concrete.

For straight or moderately curved structures, with curved or straight cables, the value of prestressing force  $P_x$  at a distance  $x$  metres from tensioning end and acting in the direction of the tangent to the curve of the cable, shall be calculated as below:

$$P_x = P_o e^{-(\mu\alpha + kx)}$$

where

$P_o$  = prestressing force in the prestressed steel at the tensioning end acting in the direction of the tangent to the curve of the cable,

## IS : 1343 - 1980

- $\alpha$  = cumulative angle in radians through which the tangent to the cable profile has turned between any two points under consideration,
- $\mu$  = coefficient of friction in curve; unless otherwise proved by tests,  $\mu$  may be taken as:  
0.55 for steel moving on smooth concrete,  
0.30 for steel moving on steel fixed to duct, and  
0.25 for steel moving on lead,
- $k$  = coefficient for wave effect varying from  $15 \times 10^{-4}$  to  $50 \times 10^{-4}$  per metre.

NOTE 1 — Expansion of the equation for  $P_x$  for small values of  $(\mu\alpha + kx)$  may be  $P_x = P_o (1 - \mu\alpha - kx)$ .

NOTE 2 — In circular constructions, where circumferential tendons are tensioned by jacks, values of  $\mu$  for calculating friction may be taken as:

- 0.45 for steel moving in smooth concrete,
- 0.25 for steel moving on steel bearers fixed to the concrete, and
- 0.10 for steel moving on steel rollers.

NOTE 3 — The effect of reverse friction shall be taken into consideration in such cases where the initial tension applied to a prestressing tendon is partially released and action of friction in the reverse direction causes an alteration in the distribution of stress along the length of the tendon.

### 18.6 Considerations Affecting Design Details

#### 18.6.1 Transmission Zone in Pre-tensioned Members

**18.6.1.1 Transmission length** — The considerations affecting the transmission length shall be the following:

- a) The transmission length depends on a number of variables, the most important being the strength of concrete at transfer, the size and type of tendon, the surface deformations of the tendon, and the degree of compactness of the concrete around the tendon.
- b) The transmission length may vary depending on the site conditions and therefore should be determined from tests carried out under the most unfavourable conditions. In the absence of values based on actual tests, the following values may be used, provided the concrete is well-compacted, and its strength at transfer is not less than  $35 \text{ N/mm}^2$  and the tendon is released gradually:

1) For plain and indented wire	100 $\phi$
2) For crimped wires	65 $\phi$
3) Strands	30 $\phi$

NOTE 1 —  $\phi$  is the diameter of the tendon.

NOTE 2 — The recommended values of transmission length apply to wires of diameter not exceeding 5 mm and strands of diameter not exceeding 18 mm.

- c) The development of stress in the tendon may be assumed to vary parabolically along the length of the member.
- d) For general guidance, it is recommended that one-half of the transmission length shall overhang the support in a simply supported beam. Where there is end-fixing, the whole of the transmission length shall overhang.

## 18.6.2 End Zone

### 18.6.2.1 Bearing stress

- a) On the areas immediately behind external anchorages, the permissible unit bearing stress on the concrete, after accounting for all losses due to relaxation of steel, elastic shortening, creep of concrete, slip and/or seating of anchorages, etc, shall not exceed  $0.48 f_{ci} \sqrt{\frac{A_{br}}{A_{pun}}}$  or  $0.8 f_{ci}$  whichever is smaller, where  $f_{ci}$  is the cube strength at transfer,  $A_{br}$  is the bearing area and  $A_{pun}$  is the punching area.
- b) During tensioning, the allowable bearing stress specified in a) may be increased by 25 percent, provided that this temporary value does not exceed  $f_{ci}$ .
- c) The bearing stress specified in (a) and (b) for permanent and temporary bearing stress may be increased suitably if adequate hoop reinforcement complying with IS : 456-1978\* is provided at the anchorages.
- d) When the anchorages are embedded in concrete, the bearing stress shall be investigated after accounting for the surface friction between the anchorage and the concrete.
- e) The effective punching area shall generally be the contact area of the anchorage devices which, if circular in shape, shall be replaced by a square of equivalent area. The bearing area shall be the maximum area of that portion of the member which is geometrically similar and concentric to the effective punching area.
- f) Where a number of anchorages are used, the bearing area  $A_{br}$  shall not overlap. Where there is already a compressive stress prevailing over the bearing area, as in the case of anchorage placed in the body of a structure, the total stress shall not exceed the limiting values specified in (a), (b) and (c). For stage stressing of cables, the adjacent unstressed anchorages shall be neglected when determining the bearing area.

---

\*Code of practice for plain and reinforced concrete ( *third revision* ).

18.6.2.2 *Bursting tensile forces*

- a) The bursting tensile forces in the end blocks, or regions of bonded post-tensioned members, should be assessed on the basis of the tendon jacking load. For unbonded members, the bursting tensile forces should be assessed on the basis of the tendon jacking load or the load in the tendon at the limit state of collapse, whichever is greater ( see Appendix B ).

The bursting tensile force,  $F_{bst}$  existing in an individual square end block loaded by a symmetrically placed square anchorage or bearing plate, may be derived from the equation below:

$$\frac{F_{bst}}{P_k} = 0.32 - 0.3 \frac{y_{po}}{y_o}$$

where

$F_{bst}$  = bursting tensile force,

$P_k$  = load in the tendon assessed as above,

$y_{po}$  = side of loaded area, and

$y_o$  = side of end block.

- b) The force  $F_{bst}$  will be distributed in a region extending from  $0.1 y_o$  to  $y_o$  from the loaded face of the end block. Reinforcement provided to sustain the bursting tensile force may be assumed to be acting at its design strength (0.87 times characteristic strength of reinforcement) except that the stress should be limited to a value corresponding to a strain of 0.001 when the concrete cover to the reinforcement is less than 50 mm.
- c) In rectangular end blocks, the bursting tensile forces in the two principal directions should be assessed on the basis of **18.6.2.2**. When circular anchorage or bearing plates are used, the side of the equivalent square area should be used. Where groups of anchorages or bearing plates occur, the end blocks should be divided into a series of symmetrically loaded prisms and each prism treated in the above manner. For designing end blocks having a cross-section different in shape from that of the general cross-section of the beam, reference should be made to specialist literature.
- d) Compliance with the requirements of (a), (b) and (c) will generally ensure that bursting tensile forces along the load axis are provided for. Alternative methods of design which make allowance for the tensile strength of the concrete may be used, in which case reference should be made to specialist literature.
- e) Consideration should also be given to the spalling tensile stresses that occur in end blocks where the anchorage or bearing plates are highly eccentric; these reach a maximum at the loaded face.

### 18.6.3 *Detailing of Reinforcement in Prestressed Concrete*

**18.6.3.1** The detailing of reinforcement in prestressed concrete shall generally conform to the requirements given in IS : 456-1978\*. In addition, the requirements of **18.6.3.2** and **18.6.3.3** shall be satisfied.

#### **18.6.3.2** *Transverse reinforcement*

- a) The amount and spacing of transverse reinforcement shall be governed by shear and torsion considerations. It is, however, desirable to provide transverse reinforcement in the web when the web is thin and cables are located in the web.
- b) In case of all members subjected to dynamic loading, webs shall be provided with transverse reinforcement, not less than 0.3 percent of the sectional area of the web in plan. This percentage of reinforcement may be reduced to 0.2 percent in members where the depth of the web is not more than four times the thickness of the web. These values may be reduced to 0.2 and 0.15 percent respectively when high strength reinforcement is used.
- c) In case of members not subjected to dynamic loading, reinforcement shall be provided when the depth of the web is more than 4 times the thickness. Such reinforcement shall not be less than 0.1 percent of the sectional area of the web in plan. The reinforcement shall be spaced at a distance not greater than the clear depth of the web and the size of such reinforcement shall be as small as possible.
- d) Reinforcement in the form of links or helix shall be provided perpendicular to the line of heavy compression or shock loading to resist the induced tensile stresses.

#### **18.6.3.3** *Longitudinal reinforcement*

- a) A minimum longitudinal reinforcement of 0.2 percent of the total concrete area shall be provided in all cases except in the case of pretensioned units of small sections. This reinforcement may be reduced to 0.15 percent in the case of high yield strength deformed reinforcement. The percentage of steel provided, both tensioned and untensioned taken together, should be sufficient so that when the concrete in the precompressed tensile zone cracks, the steel is in a position to take up the additional tensile stress transferred on to it by the cracking of the adjacent fibres of concrete and a sudden failure is avoided.
- b) When the depth of the web exceeds 50 cm, longitudinal distribution reinforcement not less than 0.05 percent of the area of the web shall be provided on each face. The spacing of the individual bars of such reinforcement shall not exceed 20 cm.

---

\*Code of practice for plain and reinforced concrete (*third revision*).

- c) All untensioned longitudinal reinforcement shall be restrained in the lateral direction.

**18.6.4 Continuity** — In the design of continuous prestressed concrete structures, due consideration shall be given to the effects of the support restraints on both the external moment and the moment due to prestressing.

**18.6.5 Butted Assembly** — Where a butted assembly is used, or where like conditions of abuttal are employed, proper provision shall be made to transfer all shear stresses. Wherever the shear stresses exceed the limits specified under **22.4**, this provision shall include keying of all abutting faces.

## SECTION 4 STRUCTURAL DESIGN : LIMIT STATE METHOD

### 19. SAFETY AND SERVICEABILITY REQUIREMENTS

**19.1 Limit State Design** — The structural design shall be based on limit state concepts. In this method of design, the structure shall be designed to withstand safely all loads liable to act on it throughout its life; it shall also satisfy the serviceability requirements, such as limitations on deflection and cracking. The acceptable limit for the safety and serviceability requirements before failure occurs is called a 'Limit State'. The aim of design is to achieve acceptable probabilities that the structure will not become unfit for the use for which it is intended, that is, that it will not reach a limit state.

**19.1.1** All relevant limit states shall be considered in design to ensure an adequate degree of safety and serviceability. In general, the structure shall be designed on the basis of the most critical limit state and shall be checked for other limit states.

**19.1.2** For ensuring the specified objective, the design should be based on characteristic values for material strengths and applied loads, which take into account the variations in the material strengths and in the loads to be supported. The characteristic values should be based on statistical data if available; where such data are not available, they should be based on experience. The 'design values' are derived from the characteristic value through the use of partial safety factors, one for material strengths and the other for loads. In the absence of special considerations, these factors should have the values given in **20.4** according to the material, the type of loading and the limit state being considered.

**19.2 Limit State of Collapse** — The limit state of collapse of the structure or part of the structure could be assessed from rupture of one

or more critical sections and from buckling due to elastic or plastic instability (including the effects of sway where appropriate) or overturning. The resistance to bending, shear, torsion and axial loads at every section shall not be less than appropriate value at that section produced by the probable most unfavourable combination of loads on the structure using the appropriate partial safety factors.

### 19.3 Limit States of Serviceability

**19.3.1 Limit State of Serviceability : Deflection** — The deflection of a structure or part thereof shall not adversely affect the appearance or efficiency of the structure or finishes or partitions. The deflection shall generally be limited to the following:

- a) The final deflection, due to all loads including the effects of temperature, creep and shrinkage and measured from the as-cast level of the supports of floors, roofs and all other horizontal members, should not normally exceed span/250.
- b) The deflection including the effects of temperature, creep and shrinkage occurring after erection of partitions and the application of finishes should not normally exceed span/350 or 20 mm whichever is less.
- c) If finishes are to be applied to prestressed concrete members, the total upward deflection should not exceed span/300, unless uniformity of camber between adjacent units can be ensured.

**19.3.2 Limit State of Serviceability : Cracking** — Cracking of concrete shall not affect the appearance or durability of the structure. The criteria of limit state of cracking for the three types of prestressed concrete members shall be as follows:

- a) *For type 1*, no tensile stresses.
- b) *For type 2*, tensile stresses are allowed but no visible cracking.
- c) *For type 3*, cracking is allowed, but should not affect the appearance or durability of the structure; the acceptable limits of cracking would vary with the type of structure and environment and will vary between wide limits and the prediction of absolute maximum width is not possible.

NOTE — For design of type 3 members, as a guide, the following may be regarded as reasonable limits.

The surface width of cracks should not, in general, exceed 0.1 mm for members exposed to a particularly aggressive environment such as the severe category in Appendix A and not exceeding 0.2 mm for all other members.

**19.3.3** The flexural tensile stress at any section of the structure, both at transfer and under the most unfavourable combination of design loads, shall satisfy the criteria for the corresponding type of structure.



## IS : 1343 - 1980

**19.3.4 Limit State of Serviceability : Maximum Compression** — The compressive stresses both at transfer and under design loads shall be limited to the values given in **22.8** for all types of structures.

**19.3.5 Other Limit States** — Structures designed for unusual or special functions shall comply with any relevant additional limit states considered appropriate to that structure.

## 20. CHARACTERISTIC AND DESIGN VALUES AND PARTIAL SAFETY FACTORS

**20.1 Characteristic Strength of Materials** — The term ‘characteristic stress’ means that value of the strength of the material below which not more than 5 percent of the test results are expected to fall. The characteristic strength for concrete shall be in accordance with Table 1, modified by **5.2.1** regarding increase in concrete strength with age. Until the relevant Indian Standard Specifications for prestressing and reinforcing steel are modified to include the concept of characteristic strength, the characteristic strength shall be assumed as the minimum ultimate tensile stress/breaking load for prestressing steel and as the minimum yield/0.2 percent proof stress for reinforcing steel, specified in the relevant Indian Standard Specifications.

**20.2 Characteristic Loads** — The term ‘characteristic load’ means that value of load which has a 95 percent probability of not being exceeded during the life of the structure. Since data are not available to express loads in statistical terms, for the purpose of this code, the dead loads given in IS : 1911-1967\*, live and wind loads given in IS : 875-1964† and seismic forces given in IS : 1893-1975‡ shall be assumed as the characteristic loads.

### 20.3 Design Values

**20.3.1 Materials** — The design strength of the materials,  $f_d$  is given by

$$f_d = \frac{f}{\gamma_m}$$

where

- $f_d$  = characteristic strength of the material ( see **20.1** ), and  
 $\gamma_m$  = partial safety factor appropriate to the material and the limit state being considered ( see **20.4** ).

**20.3.2 Loads** — The design load,  $F_d$  is given by

$$F_d = F\gamma_f$$

---

\*Schedule of unit weights of building materials ( *first revision* ).

†Code of practice for structural safety of buildings : Loading standards ( *revised* ).

‡Criteria for earthquake resistant design of structures ( *third revision* ).

where

F = characteristic load ( see **20.2** ), and

$\gamma_f$  = partial safety factor appropriate to the nature of loading and the limit state being considered ( see **20.4** ).

**20.3.3 Consequences of Attaining Limit State** — Where the consequences of a structure attaining a limit state are of a serious nature such as huge loss of life and disruption of the economy, higher values for  $\gamma_m$  and  $\gamma_f$  than those given under **20.4.1** and **20.4.2** may be applied.

## 20.4 Partial Safety Factors

### 20.4.1 Partial Safety Factor $\gamma_m$ for Material Strength

**20.4.1.1** When assessing the strength of a structure or structural member for the limit state of collapse, the values of partial safety factor  $\gamma_m$  should be taken as **1.5** for concrete and **1.15** for steel.

NOTE —  $\gamma_m$  values are already incorporated in the equations and tables given in this code.

**20.4.1.2** When assessing the deflection, the material properties such as modulus of elasticity of concrete should be taken as those associated with the characteristic strength of the material and safety factor shall not be applied.

**20.4.2 Partial Safety Factor  $\gamma_f$  for Loads** — The value of  $\gamma_f$  given in Table 5 shall normally be used.

## 21. ANALYSIS

**21.1 Analysis of Structure** — Methods of analysis as in IS : 456-1978\* shall be used. The material strength to be assumed shall be characteristic values in the determination of elastic properties of members, irrespective of the limit state being considered. Redistribution of the calculated moments may be made as given in **21.1.1**.

**21.1.1 Redistribution of Moments in Continuous Beams and Frames** — The redistribution of moments may be carried out satisfying the following conditions:

- a) Equilibrium between the internal forces and the external loads is maintained.
- b) The ultimate moment of resistance provided at any section of a member is not less than 80 percent of the moment at that section, obtained from an elastic maximum moment diagram covering all appropriate combinations of loads.

---

\*Code of practice for plain and reinforced concrete ( *third revision* ).

**TABLE 5 VALUES OF PARTIAL SAFETY FACTOR  $\gamma_f$  FOR LOADS**  
( Clause 20.4.2 )

LOAD COMBINATION	LIMIT STATE OF COLLAPSE			LIMIT STATES OF SERVICEABILITY		
	<i>DL</i>	<i>LL</i>	<i>WL</i>	<i>DL</i>	<i>LL</i>	<i>WL</i>
(1)	(2)	(3)	(4)	(5)	(6)	(7)
<i>DL + LL</i>	1.5			1.0	1.0	—
<i>DL + WL</i>	1.5 or 0.9 ( see Note 2 )			1.0	—	1.0
<i>DL + LL + WL</i>	1.2			1.0	0.8	0.8

NOTE 1 — *DL* is the dead load, *LL* is the live load and *WL* is the wind load.

NOTE 2 — This value of 0.9 is to be considered when stability against overturning or stress reversal is critical.

NOTE 3 — While considering earthquake effects, substitute *EL* for *WL*.

NOTE 4 — For the limit states of serviceability, the values of  $\gamma_f$  given in this table are applicable for short-term effects. While assessing the long-term effects due to creep, the dead load and that part of the live load likely to be permanent may only be considered.

- c) The elastic moment at any section in a member due to a particular combination of loads shall not be reduced by more than 20 percent of the numerically largest moment given anywhere by the elastic maximum moment diagram for the particular member, covering all appropriate combination of loads.
- d) At sections where the moment capacity after redistribution is less than that from the elastic maximum moment diagram, the following relationship shall be satisfied:

$$\frac{x_u}{d} + \frac{\delta_M}{100} \leq 0.5$$

where

$x_u$  = depth of neutral axis,

$d$  = effective depth, and

$\delta_M$  = percentage reduction in moment.

- e) In structures in which the structural frame provides the lateral stability, the reduction in moment allowed by condition given in 21.1.1 (c) shall be restricted to 20 percent for structures up to 4 storeys in height and 10 percent for structures over 4 storeys in height.

**21.1.2 Analysis of Slabs Spanning in Two Directions at Right Angles** — In general, the provisions of IS : 456-1978\* shall apply.

\*Code of practice for plain and reinforced concrete ( *third revision* ).

## 22. LIMIT STATE OF COLLAPSE

### 22.1 Limit State of Collapse : Flexure

**22.1.1 Assumptions** — Design for the limit state of collapse in flexure shall be based on the assumptions given below:

- a) Plane sections normal to the axis remain plane after bending.
- b) The maximum strain in concrete at the outermost compression fibre is taken as 0.003 5 in bending.
- c) The relationship between the compressive stress distribution in concrete and the strain in concrete may be assumed to be rectangle, trapezoid, parabola or any other shape which results in prediction of strength in substantial agreement with the results of tests. An acceptable stress-strain curve is given in Fig. 3. For design purposes, the compressive strength of concrete in the structure shall be assumed to be 0.67 times the characteristic strength. The partial safety factor  $\gamma_m = 1.5$  shall be applied in addition to this.

NOTE — For the stress-strain curve in Fig. 3, the design stress block parameters for rectangular section are as follows ( see Fig. 4 ) :

Area of stress block =  $0.36f_{ck} \cdot x_u$

Depth of centre of compressive force from the extreme fibre in compression =  $0.42 x_u$

where

$f_{ck}$  = characteristic compressive strength of concrete, and  
 $x_u$  = depth of neutral axis.

- d) The tensile strength of the concrete is ignored.
- e) The stresses in bonded prestressing tendons, whether initially tensioned or untensioned, and in additional reinforcement are derived from the representative stress-strain curve for the type of steel used given by the manufacturer or typical curves given in Fig. 5 for prestressing tendons and in IS : 456-1978\* for reinforcement. For design purposes, the partial safety factor  $\gamma_m$  equal to 1.15 shall be applied.
- f) If tendons are unbonded in post-tensioned members, the stress in the tendons may be obtained from a rigorous analysis or from tests.

**22.1.2 Design Formulae** — In the absence of an analysis based on the assumptions given in 22.1.1, the moment of resistance of rectangular sections and flanged sections in which the neutral axis lies within the flange may be obtained by the procedure given in Appendix B.

For flanged sections in which the neutral axis lies outside the flange, the moment of resistance shall be determined using assumptions in 22.1.1.

---

\*Code of practice for plain and reinforced concrete ( *third revision* ).

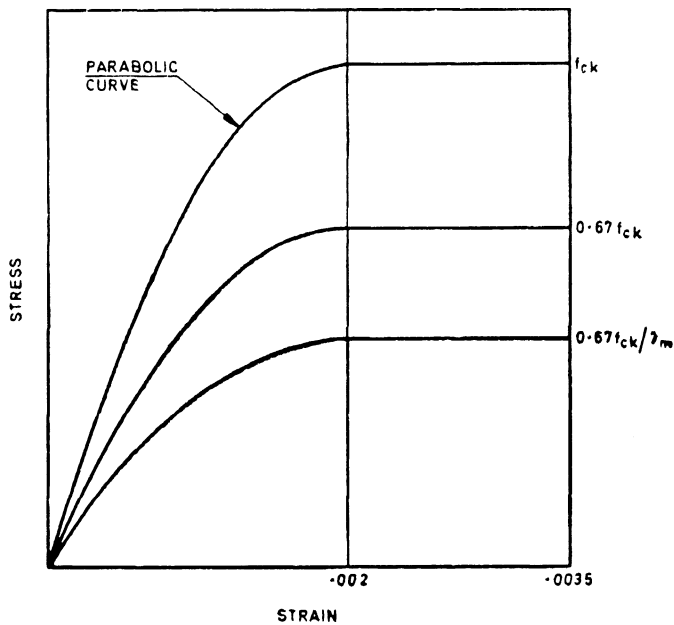


FIG. 3 STRESS STRAIN CURVE FOR CONCRETE



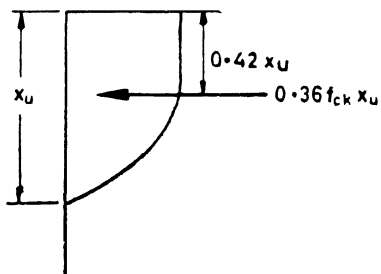


FIG. 4 STRESS BLOCK PARAMETERS

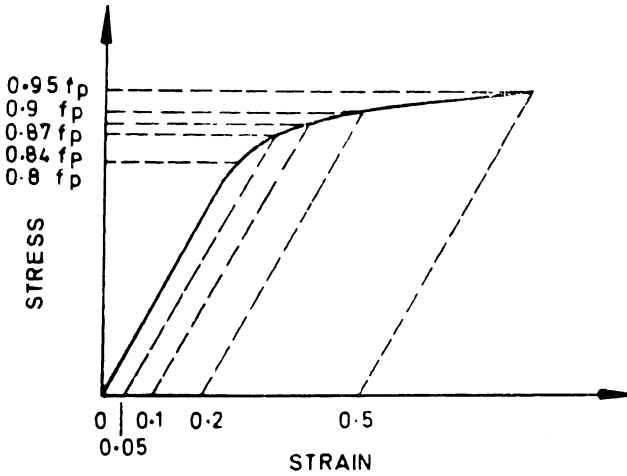

5A WIRES (STRESS RELIEVED), STRANDS AND BARS

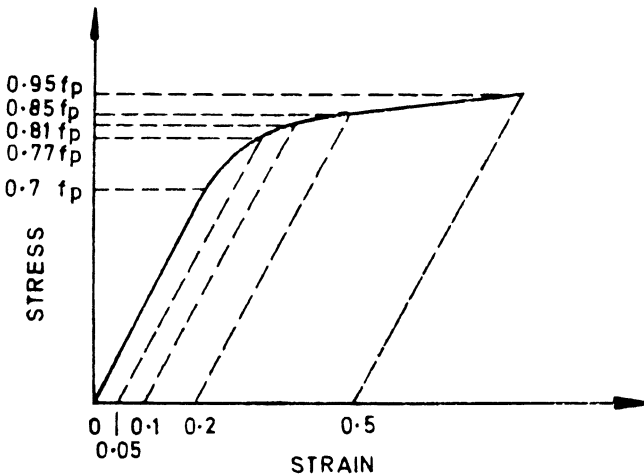

5B WIRES (AS-DRAWN)

FIG. 5 REPRESENTATIVE STRESS STRAIN CURVES FOR PRESTRESSING STEELS

## IS : 1343 - 1980

**22.2 Limit State of Collapse : Compression** — Prestressed concrete compression members in framed structures, where the mean stress in the concrete section imposed by tendons is less than  $25 \text{ N/mm}^2$ , may be analysed as reinforced concrete compression members in accordance with IS : 456-1978\*; in other cases specialist literature may be referred to.

**22.3 Limit State of Collapse : Tension** — Tensile strength of the tension members shall be based on the design strength (0.87 times characteristic strength of prestressing tendons) and the strength developed by any additional reinforcement. The additional reinforcement may usually be assumed to be acting at its design stress (0.87 times characteristic strength of reinforcement); in special cases it may be necessary to check the stress in the reinforcement using strain compatibility.

**22.4 Limit State of Collapse : Shear** — The ultimate shear resistance of the concrete alone,  $V_c$ , should be considered at both sections uncracked and cracked in flexure, the lesser value taken and, if necessary, shear reinforcement provided.

**22.4.1 Sections Uncracked in Flexure** — The ultimate shear resistance of a section uncracked in flexure,  $V_c = V_{co}$ , is given by:

$$V_{co} = 0.67 bD \sqrt{f_t^2 + 0.8 f_{cp} f_t}$$

where

$b$  = breadth of the member which for  $T$ ,  $I$  and  $L$  beams should be replaced by breadth of the rib  $b_w$ ,

$D$  = overall depth of the member,

$f_t$  = maximum principal tensile stress given by  $0.24 \sqrt{f_{ck}}$  taken as positive where  $f_{ck}$  is the characteristic compressive strength of concrete, and

$f_{cp}$  = compressive stress at centroidal axis due to prestress taken as positive.

In flanged members where the centroidal axis occurs in the flange, the principal tensile stress should be limited to  $0.24 \sqrt{f_{ck}}$  at the intersection of the flanged web; in this calculation, 0.8 of the stress due to prestress at this intersection may be used, in calculating  $V_{co}$ .

For a section uncracked in flexure and with inclined tendons or vertical prestress, the component of prestressing force normal to the longitudinal axis of the member may be added to  $V_{co}$ .

**22.4.2 Sections Cracked in Flexure** — The ultimate shear resistance of a section cracked in flexure,  $V_c = V_{cr}$ , is given by:

$$V_{cr} = \left(1 - 0.55 \frac{f_{pe}}{f_p}\right) \zeta_o bd + M_o \frac{V}{M}$$

---

\*Code of practice for plain and reinforced concrete (third revision).

where

$f_{pe}$  = effective prestress after all losses have occurred, which shall not be put greater than  $0.6 f_p$ ,

$f_p$  = characteristic strength of prestressing steel,

$\zeta_c$  = ultimate shear stress capacity of concrete obtained from Table 6,

$b$  = breadth of the member, which, for flanged sections, shall be taken as the breadth of the web  $b_w$ ,

$d$  = distance from the extreme compression-fibre to the centroid of the tendons at the section considered,

$M_o$  = moment necessary to produce zero stress in the concrete at the depth, given by:

$$M_o = 0.8 f_{pt} \frac{I}{\bar{Y}}$$

where  $f_{pt}$  is the stress due to prestress only at depth  $d$  and distance  $y$  from the centroid of the concrete section which has second moment of area  $I$ , and

$V$  and  $M$  = shear force and bending moment respectively, at the section considered due to ultimate loads.

$V_{cr}$  should be taken as not less than  $0.1 bd \sqrt{f_{ck}}$ .

**TABLE 6 DESIGN SHEAR STRENGTH OF CONCRETE,  $\zeta_c$ , N/mm<sup>2</sup>**  
( Clause 22.4.2 )

$100 \frac{A_p}{bd}$	CONCRETE GRADE		
	M 30	M 35	M 40 and Above
(1)	(2)	(3)	(4)
0.25	0.37	0.37	0.38
0.50	0.50	0.50	0.51
0.75	0.59	0.59	0.60
1.00	0.66	0.67	0.68
1.25	0.71	0.73	0.74
1.50	0.76	0.78	0.79
1.75	0.80	0.82	0.84
2.00	0.84	0.86	0.88
2.25	0.88	0.90	0.92
2.50	0.91	0.93	0.95
2.75	0.94	0.96	0.98
3.00	0.96	0.99	1.01

NOTE —  $A_p$  is the area of prestressing tendon.



## IS : 1343 - 1980

The value of  $V_{cr}$  calculated at a particular section may be assumed to be constant for a distance equal to  $d/2$ , measured in the direction of increasing moment, from that particular section.

For a section cracked in flexure and with inclined tendons, the component of prestressing forces normal to the longitudinal axis of the member should be ignored.

### 22.4.3 Shear Reinforcement

**22.4.3.1** When  $V$ , the shear force due to the ultimate loads, is less than  $V_c$ , the shear force which can be carried by the concrete, minimum shear reinforcement should be provided in the form of stirrups such that:

$$\frac{A_{sv}}{b s_v} = \frac{0.4}{0.87 f_v}$$

where

- $A_{sv}$  = total cross-sectional area of stirrup legs effective in shear,
- $b$  = breadth of the member which for  $T$ ,  $I$  and  $L$  beams should be taken as the breadth of the rib,  $b_w$ ,
- $s_v$  = stirrup spacing along the length of the member, and
- $f_v$  = characteristic strength of the stirrup reinforcement which shall not be taken greater than  $415 \text{ N/mm}^2$ .

However, shear reinforcement need not be provided in the following cases:

- a) where  $V$  is less than  $0.5 V_c$ , and
- b) in members of minor importance.

**22.4.3.2** When  $V$  exceeds  $V_c$ , shear reinforcement shall be provided such that:

$$\frac{A_{sv}}{s_v} = \frac{V - V_c}{0.87 f_v d_t}$$

In rectangular beams, at both corners in the tensile zone, a stirrup should pass around a longitudinal bar, a tendon or a group of tendons  $t$  having a diameter not less than the diameter of the stirrup. The depth  $d_t$  is then taken as the depth from the extreme compression fibre either to the longitudinal bars or to the centroid of the tendons whichever is greater.

The spacing of stirrups along a member should not exceed  $0.75 d_t$  nor 4 times the web thickness for flanged members. When  $V$  exceeds  $1.8 V_c$ , the maximum spacing should be reduced to  $0.5 d_t$ . The lateral spacing of the individual legs of the stirrups provided at a cross section should not exceed  $0.75 d_t$ .

**22.4.4 Maximum Shear Forces** — In no circumstances should the shear force  $V$ , due to ultimate loads, exceed the appropriate values given in Table 7 multiplied by  $bd$ .

Concrete Grade	M 30	M 35	M 40	M 45	M 50	M 55 and over
Maximum Shear Stress, N/mm <sup>2</sup>	3.5	3.7	4.0	4.3	4.6	4.8

## 22.5 Limit State of Collapse: Torsion

**22.5.1 General** — In general, where the torsional resistance or stiffness of members has not been taken into account in the analysis of the structure, no specific calculations for torsion will be necessary, adequate control in torsional cracking being provided by the required nominal shear reinforcement. Where the torsional resistance or stiffness of members is taken into account in the analysis, the members shall be designed for torsion.

**22.5.2 Application of Design Rules for Torsion** — The design rules laid down in **22.5.3** to **22.5.5** apply to:

- beams of solid rectangular cross-section ( $D > b$ ),
- hollow rectangular beams with  $D > b$  and with a wall thickness  $t \geq o/4$ , and
- T-beam and I-beams.

In all these cases the average intensity of prestress in the concrete shall be less than  $0.3 f_{ck}$ .

### 22.5.3 Longitudinal Reinforcement

**22.5.3.1** The longitudinal reinforcement shall be designed to resist an equivalent ultimate bending moment  $M_{e1}$  given by:

$$M_{e1} = M + M_t$$

where

$M$  = applied ultimate bending moment at the cross-section acting in combination with  $T$ ,

$$M_t = T \sqrt{\left(1 + \frac{2D}{b}\right)}, \text{ the sign of } M_t \text{ being the same as that of } M,$$

$D$  = overall depth of the beam, and

$b$  = breadth of the member which for  $T$  and  $I$  beams shall be taken as the breadth of the web,  $b_w$ .

**IS : 1343 - 1980**

**22.5.3.2** Where the numerical value of  $M$  is less than that of  $M_t$ , the member shall also be designed to withstand a moment  $M_{e2}$  given by:

$$M_{e2} = M_t - M,$$

the moment  $M_{e2}$  being taken as acting in the opposite sense to the moment  $M$ .

**22.5.3.3** Where the numerical value of  $M$  is less than or equal to that of  $M_t$ , the beam shall be designed to withstand an equivalent transverse binding moment  $M_{e3}$  (not acting simultaneously with  $M_{e1}$ ), given by:

$$M_{e3} = M_t \left( 1 + \frac{x_1}{2e} \right)^2 \left( \frac{1 + \frac{2b}{D}}{1 + \frac{2D}{b}} \right)$$

and acting about an axis at right angles to the axis of  $M$ , where  $x_1$  is the smaller dimension of a closed hoop used as torsional shear reinforcement and  $e$  is as defined in **22.5.4.1**.

**22.5.4 Transverse Reinforcement**

**22.5.4.1 Torsional moment and shear carried by concrete** — The reduced torsional moment carried by the concrete  $T_{c1}$  is given by:

$$T_{c1} = T_c \left( \frac{e}{e + e_c} \right)$$

where

$$T_c = \Sigma 1.5 b^2 D \left( 1 - \frac{b}{30} \right) \lambda_p \sqrt{f_{ck}}$$

$$e = \frac{T}{V}$$

$$e_c = \frac{T_c}{V_c}$$

$$\lambda_p = \sqrt{\left( 1 + \frac{12 f_{cp}}{f_{ck}} \right)}$$

In the above expressions,

$T_c$  = torsional moment carried by concrete,

$b$  = breadth of the member, which for T and I beams shall be taken as the breadth of the web,  $b_w$ ,

$D$  = overall depth of beam,

$f_{ck}$  = characteristic compressive strength of concrete,

$T$  = torsional moment applied to a cross-section under ultimate load conditions,

$V$  = shearing force at a cross section calculated for the specified ultimate loads,

$V_c$  = theoretical shear strength at a cross section, assuming the most unfavourable conditions for inclined cracking, that is, smaller of  $V_{co}$  and  $V_{cr}$  ( see **22.4.1** and **22.4.2** ), and

$f_{cp}$  = average intensity of effective prestress in concrete.

**22.5.4.2** The shear force carried by the concrete  $V_{c1}$  is given by:

$$V_{c1} = V_c \left( \frac{e}{e + e_c} \right)$$

where

$V_c$  = smaller of  $V_{co}$  and  $V_{cr}$  obtained as in **22.4.1** and **22.4.2**.

**22.5.4.3** *Design of transverse reinforcement* — The area of cross-section,  $A_{sv}$  of the closed stirrup enclosing the corner longitudinal bars shall be taken as the larger of the following two values:

$$A_{sv} = \frac{M_t s_v}{1.5 b_1 d_1 f_v}$$

$$\text{and } A_{sv} = A_v + 2 A_T$$

where

$$A_v = \frac{(V - V_{c1}) s_v}{0.87 f_v d_1}$$

$$A_T = \frac{(T - T_{c1}) s_v}{0.87 b_1 d_1 f_v}$$

In the above expressions,

$M_t$  = as defined in **22.5.3.1**,

$s_v$  = spacing of the stirrup reinforcement,

$b_1$  = centre to centre distance between corner bars in the direction of the width,

$d_1$  = centre to centre distance between corner bars in the direction of the depth,

$f_v$  = characteristic strength of shear reinforcement,

$V$  is as defined in **22.5.4.1**,

$V_{c1}$  is as defined in **22.5.4.2**, and

$T$  and  $T_{c1}$  are as defined in **22.5.4.1**.

**22.5.4.4** *Minimum reinforcement* — The value of  $A_{sv}$  shall not be taken lesser than that given by:

$$\frac{A_{sv}}{b_{sv}} = \frac{0.4}{0.87 f_v}$$

## IS : 1343 - 1980

There shall be at least one longitudinal bar not less than 12 mm in diameter in each corner of the stirrups.

**22.5.5 Distribution of Torsion Reinforcement** — When a member is designed for torsion, torsion reinforcement shall be provided as below:

- a) All transverse reinforcement provided for torsion shall be in the form of closed stirrups perpendicular to the axis of the members;
- b) The spacing,  $s_v$ , of the stirrups shall not exceed  $(x_1 + y_1)/4$  or 200 mm whichever is smaller, where  $x_1$  and  $y_1$  are respectively short and long dimensions of the stirrup;
- c) Each end of the bar forming the stirrup shall be anchored in accordance with IS : 456-1978\*; and
- d) Torsional reinforcement shall be continued to a distance not less than  $(D + b_w)$  beyond the point at which it is no longer than theoretically required, where  $D$  is the overall depth and  $b_w$  is the effective width of the web of a flanged member.

## 22.6 Limit State of Serviceability : Deflection

### 22.6.1 Type 1 and Type 2 Members

**22.6.1.1 Short-term deflection** — The instantaneous deflection due to design loads may be calculated using elastic analysis based on the uncracked section and the modulus of elasticity of concrete as given in 5.2.3.

**22.6.1.2 Long-term deflection** — The total long-term deflection due to the prestressing force, dead load and any sustained imposed load may be calculated using elastic analysis, taking into account the effects of cracking and of creep and shrinkage (see 5.2.4 and 5.2.5). Due allowance shall be made for the loss of prestress (see 18.5.2) after the period considered. The deflections should comply with the limits given in 19.3.1.

**22.6.2 Type 3 Members** — Where the permanent load is less than or equal to 25 percent of the design imposed load, the deflection may be calculated as in 22.6.1.1. When the permanent load is more than 25 percent of the design imposed load, the vertical deflection limits for beams and slabs may generally be assumed to be satisfied provided that the span to effective depth ratios are not greater than the values obtained as below:

- a) Basic values of span to effective depth ratios for spans up to 10 m:

Cantilever	7
Simply supported	20
Continuous	26

---

\*Code of practice for plain and reinforced concrete (third revision).

- b) For spans above 10 m, the values in (a) may be multiplied by 10/span in metres, except for cantilever in which case deflection calculations should be made.

## 22.7 Limit State of Serviceability: Cracking


**22.7.1** In members made up of precast units, no tension shall be allowed at any stage at mortar or concrete joints. For a member which is free of joints, the tensile stress shall not exceed the values specified below for the 3 types of members.

- a) *Type 1* — No tensile stress.
- b) *Type 2* — The tensile stress shall not exceed  $3 \text{ N/mm}^2$ . However, where part of the service loads is temporary in nature, this value may be exceeded by  $1.5 \text{ N/mm}^2$ , provided under the permanent component of the service load the stress remains compressive.
- c) *Type 3* — For type 3 members in which cracking is permitted, it may be assumed that the concrete section is uncracked, and that hypothetical tensile stresses exist at the maximum size of cracks. The hypothetical tensile stresses for use in these calculations for members with either pre-tensioned or post-tensioned tendons are given in Table 8, modified by coefficients given in Fig. 6.

**TABLE 8 HYPOTHETICAL FLEXURAL TENSILE STRESSES FOR TYPE 3 MEMBERS**

TYPE OF TENDONS (1)	LIMITING CRACK WIDTH (2) mm	STRESS OF CONCRETE FOR GRADE				
		M 30 (3)	M 35 (4)	M 40 (5)	M 45 (6)	M 50 and above (7)
Pre-tensioned tendons	0.1	—	—	4.1	4.4	4.8
	0.2	—	—	5.0	5.4	5.8
Grouted post-tensioned tendons	0.1	3.2	3.6	4.1	4.4	4.8
	0.2	3.8	4.4	5.0	5.4	5.8
Pre-tensioned tendons distributed in the tension zone and positioned close to the tension faces of concrete	0.1	—	—	5.3	5.8	6.3
	0.2	—	—	6.3	6.8	7.3

NOTE — When additional reinforcement is distributed within the tension zone and positioned close to the tension face of concrete, the hypothetical tensile stresses may be increased by an amount which is proportional to the cross-sectional areas of the additional reinforcement expressed as a percentage of the cross-sectional area of the concrete. For 1 percent of additional reinforcement, the stress may be increased by  $4 \text{ N/mm}^2$  for members with pre-tensioned and grouted post-tensioned tendons and by  $3 \text{ N/mm}^2$  for other members. For other percentages of additional reinforcement the stresses may be increased in proportion excepting that the total hypothetical tensile stress shall not exceed 0.25 times the characteristic compressive strength of concrete.

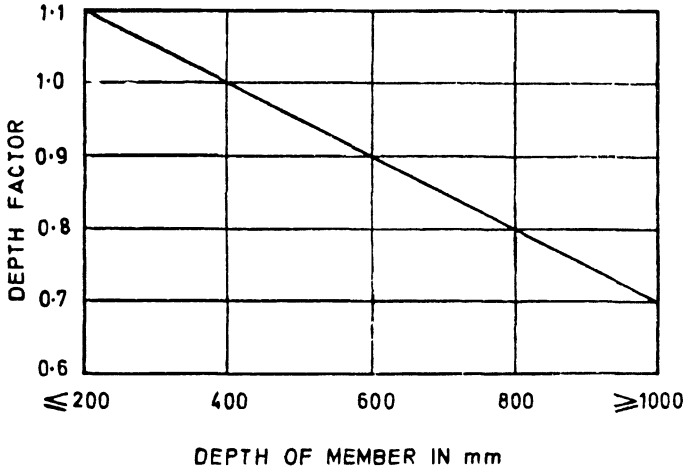

NOTE — The values in Table 8 shall be multiplied by the factors obtained from the figure depending on the depth of the member.

FIG. 6 DEPTH FACTORS FOR TENSILE STRESSES FOR TYPE 3 MEMBERS

**22.8 Limit State of Serviceability: Maximum Compression**

**22.8.1 Maximum Stress Under Service Conditions**

**22.8.1.1 Compressive stress in flexure** — The maximum permissible compressive stress, prestress and service loads after deduction of the full losses in the specified prestress shall be determined by a straight line relation as in Fig. 7; but different stress limits shall apply to the concrete of the structure depending on whether it falls in a part of the section where the compressive stresses are not likely to increase in service (Zone I) or in part of the section where the compressive stresses are likely to increase in service (Zone II) ( see Fig. 7 ).

For Zone I, the straight line relation of permissible stress shall be determined by the straight line joining a point given by a permissible stress of  $0.41 f_{ck}$  for concrete of Grade M 30 to another point given by a permissible stress of  $0.35 f_{ck}$  for concrete of Grade M 60.

For Zone II, the determining points of the graph shall be reduced to  $0.34 f_{ck}$  and  $0.27 f_{ck}$  respectively.

**22.8.1.2 Stress in direct compression** — Except in the parts immediately behind the anchorage, the maximum stress in direct compression shall be limited to 0.8 times the permissible stress obtained from **22.8.1.1**.

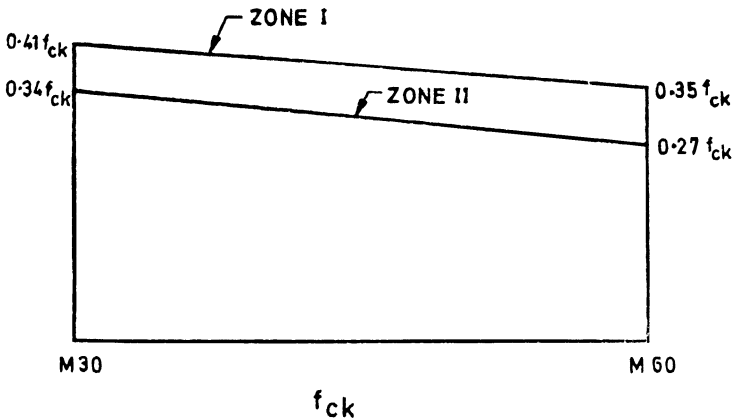


FIG. 7 COMPUTATION OF MAXIMUM PERMISSIBLE COMPRESSIVE STRESS IN FLEXURE DUE TO FINAL PRESTRESS


### 22.8.2 Maximum Stress at Transfer

**22.8.2.1 Compressive stress in flexure** — The maximum permissible compressive stress due to bending and direct force at the time of transfer of prestress shall be determined from a graph in which a straight line joins a point given by  $0.54 f_{ci}$  for a concrete of Grade M30 to a second point giving a permissible stress of  $0.37 f_{ci}$  for concrete of Grade M60 (see Fig. 8A);  $f_{ci}$  being cube strength of concrete at transfer which in no case shall be less than half the corresponding characteristic compressive strength of concrete. These values apply to post-tensioned work; for pre-tensioned work the variation represented by Fig. 8B will apply.


NOTE — The strength of concrete at the time of transfer  $f_{ci}$  shall be established by tests carried out on cubes at the age of the concrete at transfer for bridges and such other major structures and in other cases, if more convenient, from the straight line graph, joining the characteristic compressive strength of concrete and cube strength at 7 days. The transfer of prestress shall be made only after the concrete has attained a strength of at least half the characteristic compressive strength of concrete.

**22.8.2.2 Stress in direct compression** — Except in the parts immediately behind the anchorages, the maximum stress in direct compression shall be limited to 0.8 times the permissible stress obtained from 22.8.2.1.



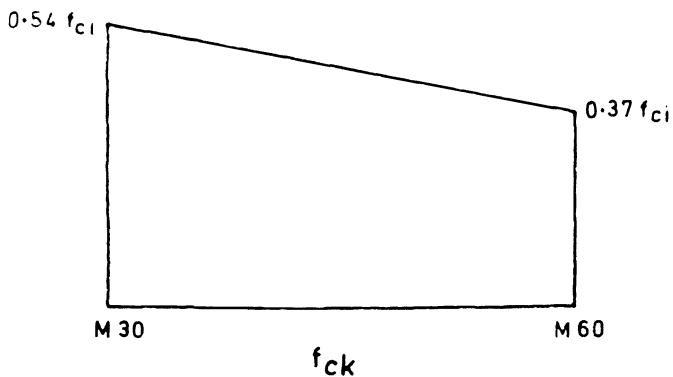

8A POST TENSIONED WORK

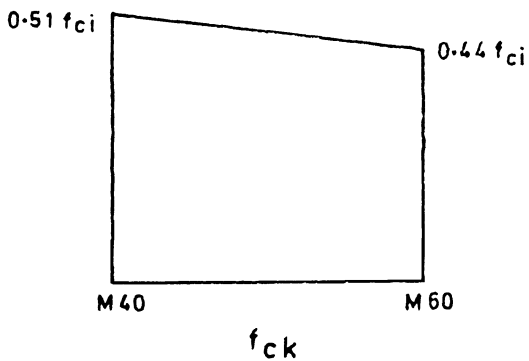

8B PRE - TENSIONED WORK

FIG. 8 COMPUTATION OF MAXIMUM PERMISSIBLE COMPRESSIVE STRESS IN FLEXURE AT TRANSFER

# APPENDIX A

( Clauses 7.2 and 19.3.2 )

## REQUIREMENTS FOR DURABILITY

**A-1.** Minimum cement contents for different exposures and sulphate attack are given in Tables 9 and 10 for general guidance.

**TABLE 9 MINIMUM CEMENT CONTENT REQUIRED IN CEMENT  
CONCRETE TO ENSURE DURABILITY UNDER SPECIFIED  
CONDITIONS OF EXPOSURE**

EXPOSURE	PRESTRESSED CONCRETE	
	Minimum Cement Content kg/m <sup>3</sup>	Maximum Water- Cement Ratio
<i>Mild</i> — For example, completely protected against weather, or aggressive conditions, except for a brief period of exposure to normal weather conditions during construction	300	0.65
<i>Moderate</i> — For example, sheltered from heavy and wind driven rain and against freezing, whilst saturated with water, buried concrete in soil and concrete continuously under water	300	0.55
<i>Severe</i> — For example, exposed to sea water, alternate wetting and drying and to freezing whilst wet subject to heavy condensation or corrosive fumes	360	0.45

NOTE — The minimum cement content is based on 20 mm nominal maximum size. For 40 mm aggregate, minimum cement content should be reduced by about 10 percent under severe exposure condition only; for 12.5 mm aggregate, the minimum cement content should be increased by about 10 percent under moderate and severe exposure conditions only.

**A-2.** To minimize the chances of deterioration of concrete from harmful chemical salts, the levels of such harmful salts in concrete coming from the concrete materials, that is, cement, aggregates, water and admixtures as well as by diffusion from the environments should be limited. Generally, the total amount of chlorides (as Cl<sup>-</sup>) and the total amount of soluble sulphates (as SO<sub>3</sub><sup>-</sup>) in the concrete at the time of placing should be limited to 0.06 percent by mass of cement and 4 percent by mass of cement respectively.

**TABLE 10 REQUIREMENTS FOR CONCRETE EXPOSED TO SULPHATE ATTACK**

( Clause A-1 )

CLASS	CONCENTRATION OF SULPHATES EXPRESSED AS SO <sub>3</sub>			TYPE OF CEMENT		REQUIREMENTS FOR DENSE, FULLY COMPACTED CONCRETE MADE WITH AGGREGATES COMPLYING WITH IS : 383-1970*	
	In Soil		In Ground Water (Parts per 100 000)			Minimum Cement Content	Maximum Free Water/Cement Ratio
	Total SO <sub>3</sub> (Percent)	SO <sub>3</sub> in 2 : 1 Water Extract g/l		(6)	(7)		
(1)	(2)	(3)	(4)	(5)	(6)	(7)	kg/m <sup>3</sup>
1.	Less than 0.2	—	Less than 30	Ordinary Portland cement or Portland slag cement	280	0.55	
2.	0.2 to 0.5	—	30 to 120	Ordinary Portland cement (see Note 5) or Portland slag cement	330	0.50	
3.	0.5 to 1.0	1.9 to 3.1	120 to 250	Ordinary Portland cement (see Note 5)	330	0.50	

NOTE 1 — This table applies only to concrete made with 20 mm aggregates complying with the requirements of IS : 383-1970\* placed in near-neutral groundwaters of pH 6 to pH 9, containing naturally occurring sulphates but not contaminants such as ammonium salts. For 40 mm aggregate, the value may be reduced by about 15 percent and for 12.5 mm aggregate, the value may be increased by about 15 percent. Concrete prepared from ordinary Portland cement would not be recommended in acidic conditions (pH 6 or less).

NOTE 2 — The cement contents given in Class 2 are the minimum recommended. For SO<sub>3</sub> contents near the upper limit of Class 2, cement contents above these minimum are advised.

NOTE 3 — Where the total SO<sub>3</sub> in col 2 exceeds 0.5 percent, then a 2 : 1 water extract may result in a lower site classification if much of the sulphate is present as low solubility calcium sulphate.

NOTE 4 — For severe conditions such as thin sections under hydro-static pressure on one side only and sections partly immersed, considerations should be given to a further reduction of water cement ratio, and if necessary an increase in the cement content to ensure the degree of workability needed for full compaction and thus minimum permeability.

NOTE 5 — For class 3, ordinary Portland cement with C<sub>3</sub>A content not more than 5 percent and 2C<sub>3</sub>A + C<sub>4</sub>AF (or its solid solution 4CaO, Al<sub>2</sub>O<sub>3</sub>, Fe<sub>2</sub>O<sub>3</sub> + 2CaO, Fe<sub>2</sub>O<sub>3</sub>) not more than 20 percent is recommended. If this cement is used for class 2, minimum cement content may be reduced to 310 kg/m<sup>3</sup>.

\*Specification for coarse and fine aggregates from natural sources for concrete (second revision).

## APPENDIX B

( Clauses 18.6.2.2 and 22.1.2 )

### MOMENTS OF RESISTANCE FOR RECTANGULAR AND T-SECTIONS

**B-1.** The moment of resistance of rectangular sections or T-sections in which neutral axis lies within the flange may be obtained as follows;

$$M = f_{pu} A_p ( d - 0.42 x_u )$$

where

- $M$  = moment of resistance of the section,
- $f_{pu}$  = ultimate tensile stress in the tendons,
- $A_p$  = area of pretensioning tendons,
- $d$  = effective depth, and
- $x_u$  = neutral axis depth

For pretensioned members and for post-tensioned members with effective bond between the concrete and tendons, values of  $f_{pu}$  and  $x_u$  are given in Table 11. The effective prestress after all losses should not be less than  $0.45 f_p$ , where  $f_p$  is the characteristic strength of prestressing steel.

For post-tensioned members with unbonded tendons, the values of  $f_{pu}$  and  $x_u$  are given in Table 12.

**TABLE 11 CONDITIONS AT THE ULTIMATE LIMIT STATE FOR  
RECTANGULAR BEAMS WITH PRE-TENSIONED TENDONS OR WITH  
POST-TENSIONED TENDONS HAVING EFFECTIVE BOND**

$\frac{A_p f_p}{b d f_{ck}}$	STRESS IN TENSION AS A PROPORTION OF THE DESIGN STRENGTH		RATIO OF THE DEPTH OF NEUTRAL AXIS TO THAT OF THE CENTROID OF THE TENDON IN THE TENSION ZONE	
	$\frac{f_{pu}}{0.87 f_p}$		$x_u/d$	
	Pre-tensioning	Post-tensioning with effective bond	Pre-tensioning	Post-tensioning with effective bond
(1)	(2)	(3)	(4)	(5)
0.025	1.0	1.0	0.054	0.054
0.05	1.0	1.0	0.109	0.109
0.10	1.0	1.0	0.217	0.217
0.15	1.0	1.0	0.326	0.316
0.20	1.0	0.95	0.435	0.414
0.25	1.0	0.90	0.542	0.488
0.30	1.0	0.85	0.655	0.558
0.40	0.9	0.75	0.783	0.653

**TABLE 12 CONDITIONS AT THE ULTIMATE LIMIT STATE FOR  
POST-TENSIONED RECTANGULAR BEAMS HAVING  
UNBONDED TENDONS**  
( Clause B-1 )

$\frac{A_p f_p}{bd f_{ck}}$	STRESS IN TENDONS AS A PROPORTION OF THE EFFECTIVE PRESTRESS $f_{pu}/f_p$ FOR VALUES OF $l/d$ $\left( \frac{\text{EFFECTIVE SPAN}}{\text{EFFECTIVE DEPTH}} \right)$			RATIO OF DEPTH OF NEUTRAL AXIS TO THAT OF THE CENTROID OF THE TENDONS IN THE TENSION ZONE $x_u/d$ FOR VALUES OF $l/d$ $\left( \frac{\text{EFFECTIVE SPAN}}{\text{EFFECTIVE DEPTH}} \right)$		
	30	20	10	30	20	10
(1)	(2)	(3)	(4)	(5)	(6)	(7)
0.025	1.23	1.34	1.45	0.10	0.10	0.10
0.05	1.21	1.32	1.45	0.16	0.16	0.18
0.10	1.18	1.26	1.45	0.30	0.32	0.36
0.15	1.14	1.20	1.36	0.44	0.46	0.52
0.20	1.11	1.16	1.27	0.56	0.58	0.64

(Continued from page 2)

## Prestressed Concrete Subcommittee, BDC 2 : 8

<i>Members</i>	<i>Representing</i>
ADDITIONAL DIRECTOR, STANDARDS (B & S) DEPUTY DIRECTOR, STANDARDS (B & S) ( <i>Alternate</i> )	Research Designs & Standards Organization (Ministry of Railways), Lucknow
SHRI C. R. ALIMCHANDANI SHRI M. C. TANDON ( <i>Alternate</i> )	Stup Consultants Ltd, Bombay
DIRECTOR (CANALS) DEPUTY DIRECTOR (CANALS) ( <i>Alternate</i> )	Central Water Commission, New Delhi
SHRI D. T. GROVER SHRI A. S. BISHNOI ( <i>Alternate</i> )	Roads Wing, Ministry of Shipping and Transport
SHRI S. Y. KHAN SHRI S. M. BILGRAMI ( <i>Alternate</i> )	Killick Nixon Ltd, Bombay
SHRI G. K. MAJUMDAR SHRI H. S. PASRICHA ( <i>Alternate</i> )	Hindustan Prefab Ltd, New Delhi
SHRI D. B. NAIK SHRI SUCHA SINGH ( <i>Alternate</i> )	Engineer-in-Chief's Branch, Army Headquarters
SHRI K. K. NAMBIAR	In personal capacity ('Ramanalaya' 11 First Crescent Park Road, Gandhi Nagar, Adyar, Madras)
SHRI B. K. PANTHAKY SHRI V. S. PARAMESWARAN	The Hindustan Construction Co Ltd, Bombay Structural Engineering Research Centre (CSIR), Roorkee
SHRI A. S. P. RAO ( <i>Alternate</i> )	
DR A. V. R. RAO SHRI K. S. SRINIVASAN ( <i>Alternate</i> )	National Buildings Organization, New Delhi
SHRI T. N. S. RAO SHRI S. R. PINHEIRO ( <i>Alternate</i> )	Gammon India Ltd, Bombay
SUPERINTENDING SURVEYOR OF WORKS (NDZ) SURVEYOR OF WORKS III (NDZ) ( <i>Alternate</i> )	Central Public Works Department, New Delhi
SHRI B. T. UNWALLA SHRI N. C. DUGGAL ( <i>Alternate</i> )	The Concrete Association of India, Bombay
DR H. C. VISVESVARAYA SHRI S. SUBRAMANIAN ( <i>Alternate</i> )	Cement Research Institute of India, New Delhi

## Panel for Revision of Concrete Codes, BDC 2 : 2/2 : 8/P : 1

<i>Convener</i>	
DR H. C. VISVESVARAYA	Cement Research Institute of India, New Delhi
<i>Members</i>	
DR IQBAL ALI DR A. K. MULLICK SHRI P. PADMANABHAN (OFFICER ON SPECIAL DUTY)	Engineering Research Laboratories, Hyderabad Cement Research Institute of India, New Delhi Indian Standards Institution
SHRI V. S. PARAMESWARAN	Structural Engineering Research Centre (CSIR), Madras
SHRI V. K. GHANEKAR	Structural Engineering Research Centre (CSIR), Roorkee

(Continued on page 62)

## IS : 1343 - 1980

( Continued from page 61 )

### *Members*

SHRI S. R. PINHEIRO  
DR G. P. SAHA ( *Alternate* )  
SHRI D. AJITHA SIMHA  
SHRI C. N. SRINIVASAN  
SHRI S. SUBRAMANIAN  
SHRI B. T. UNWALLA  
SHRI Y. K. MEHTA ( *Alternate* )

### *Representing*

Gammon India Ltd, Bombay  
Indian Standards Institution  
M/s C. R. Narayana Rao, Madras  
Cement Research Institute of India, New Delhi  
The Concrete Association of India, Bombay

## Working Group for Revision of IS : 456 and IS : 1343

### *Convener*

SHRI D. AJITHA SIMHA                      Indian Standards Institution

### *Members*

SHRI V. K. GHANEKAR                      Structural Engineering Research Centre (CSIR),  
Roorkee  
SHRI M. N. NEELAKANDHAN              Indian Standards Institution  
SHRI P. PADMANABHAN                    Indian Standards Institution  
(OFFICER ON SPECIAL DUTY)  
SHRI S. SUBRAMANIAN                    Cement Research Institute of India, New Delhi

